

FIG. 1



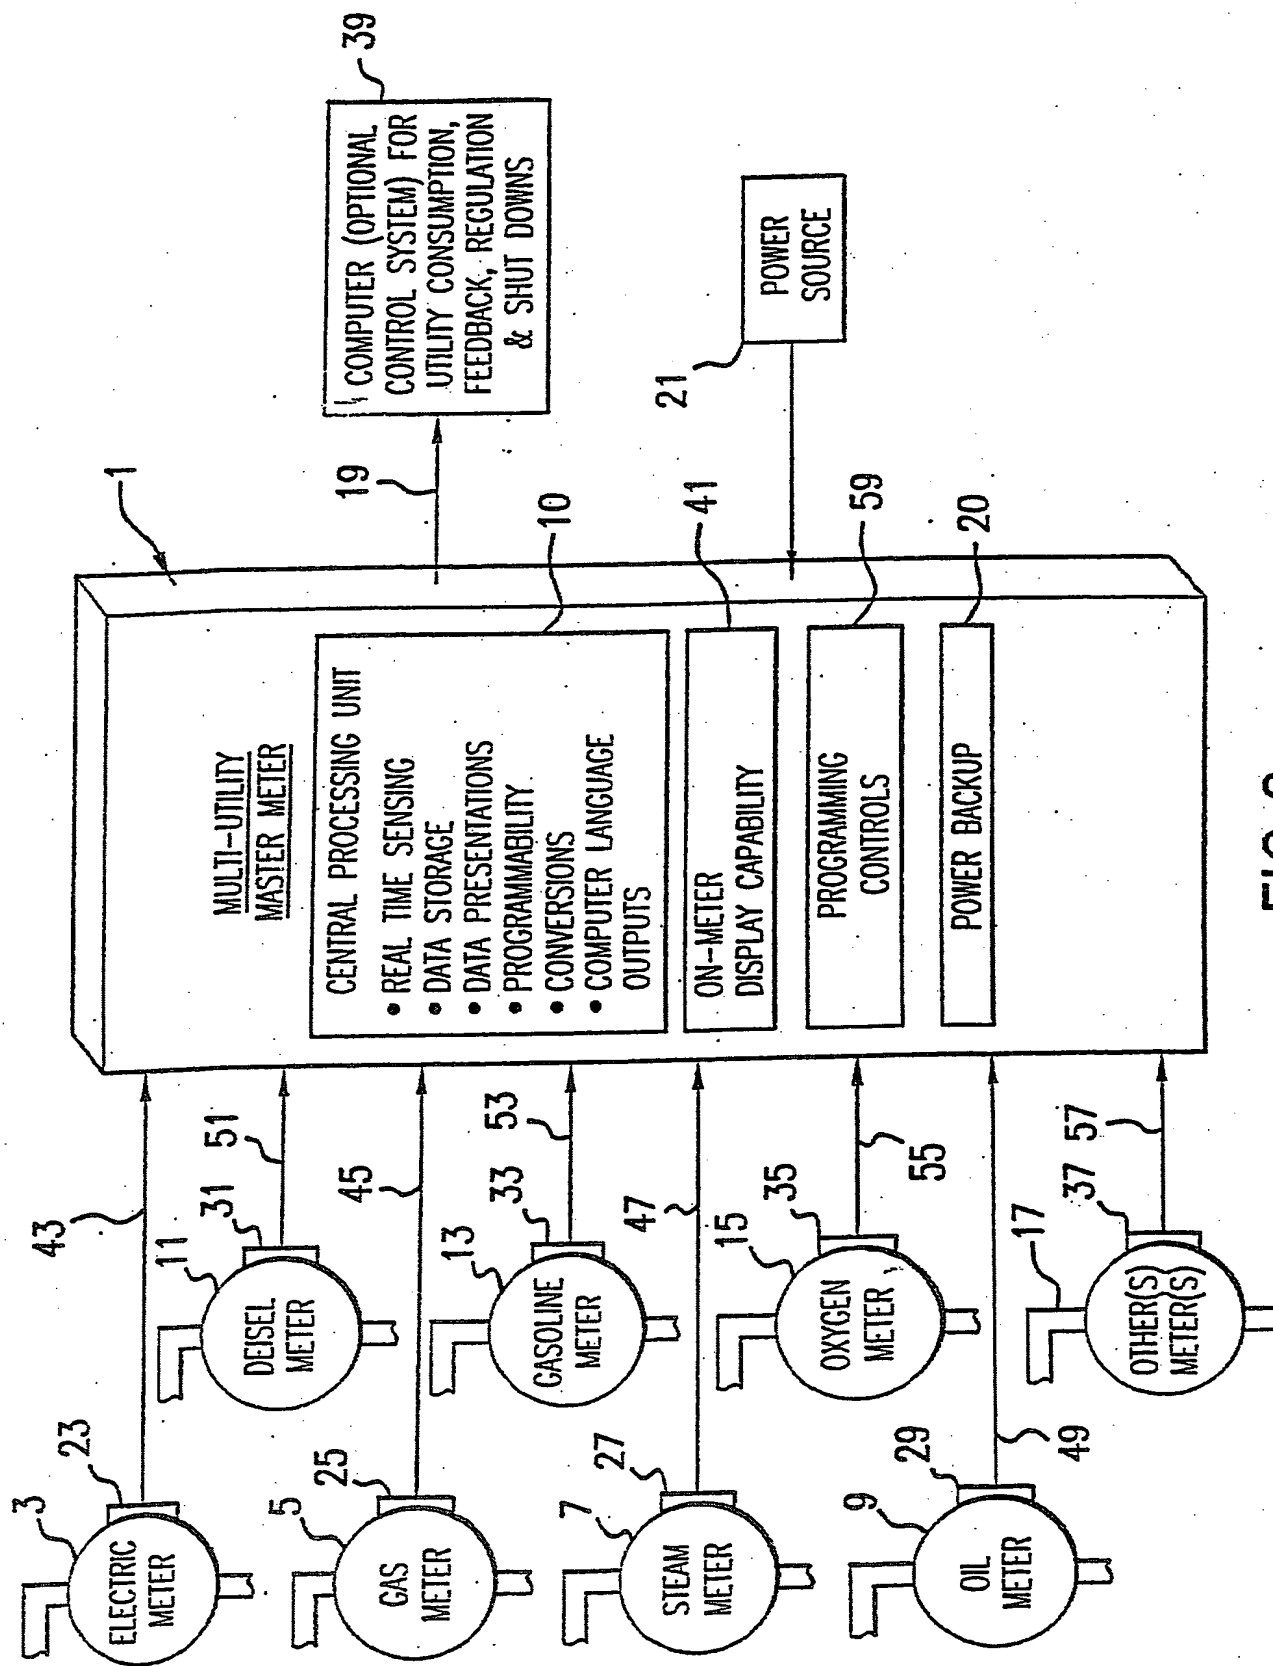


FIG. 2

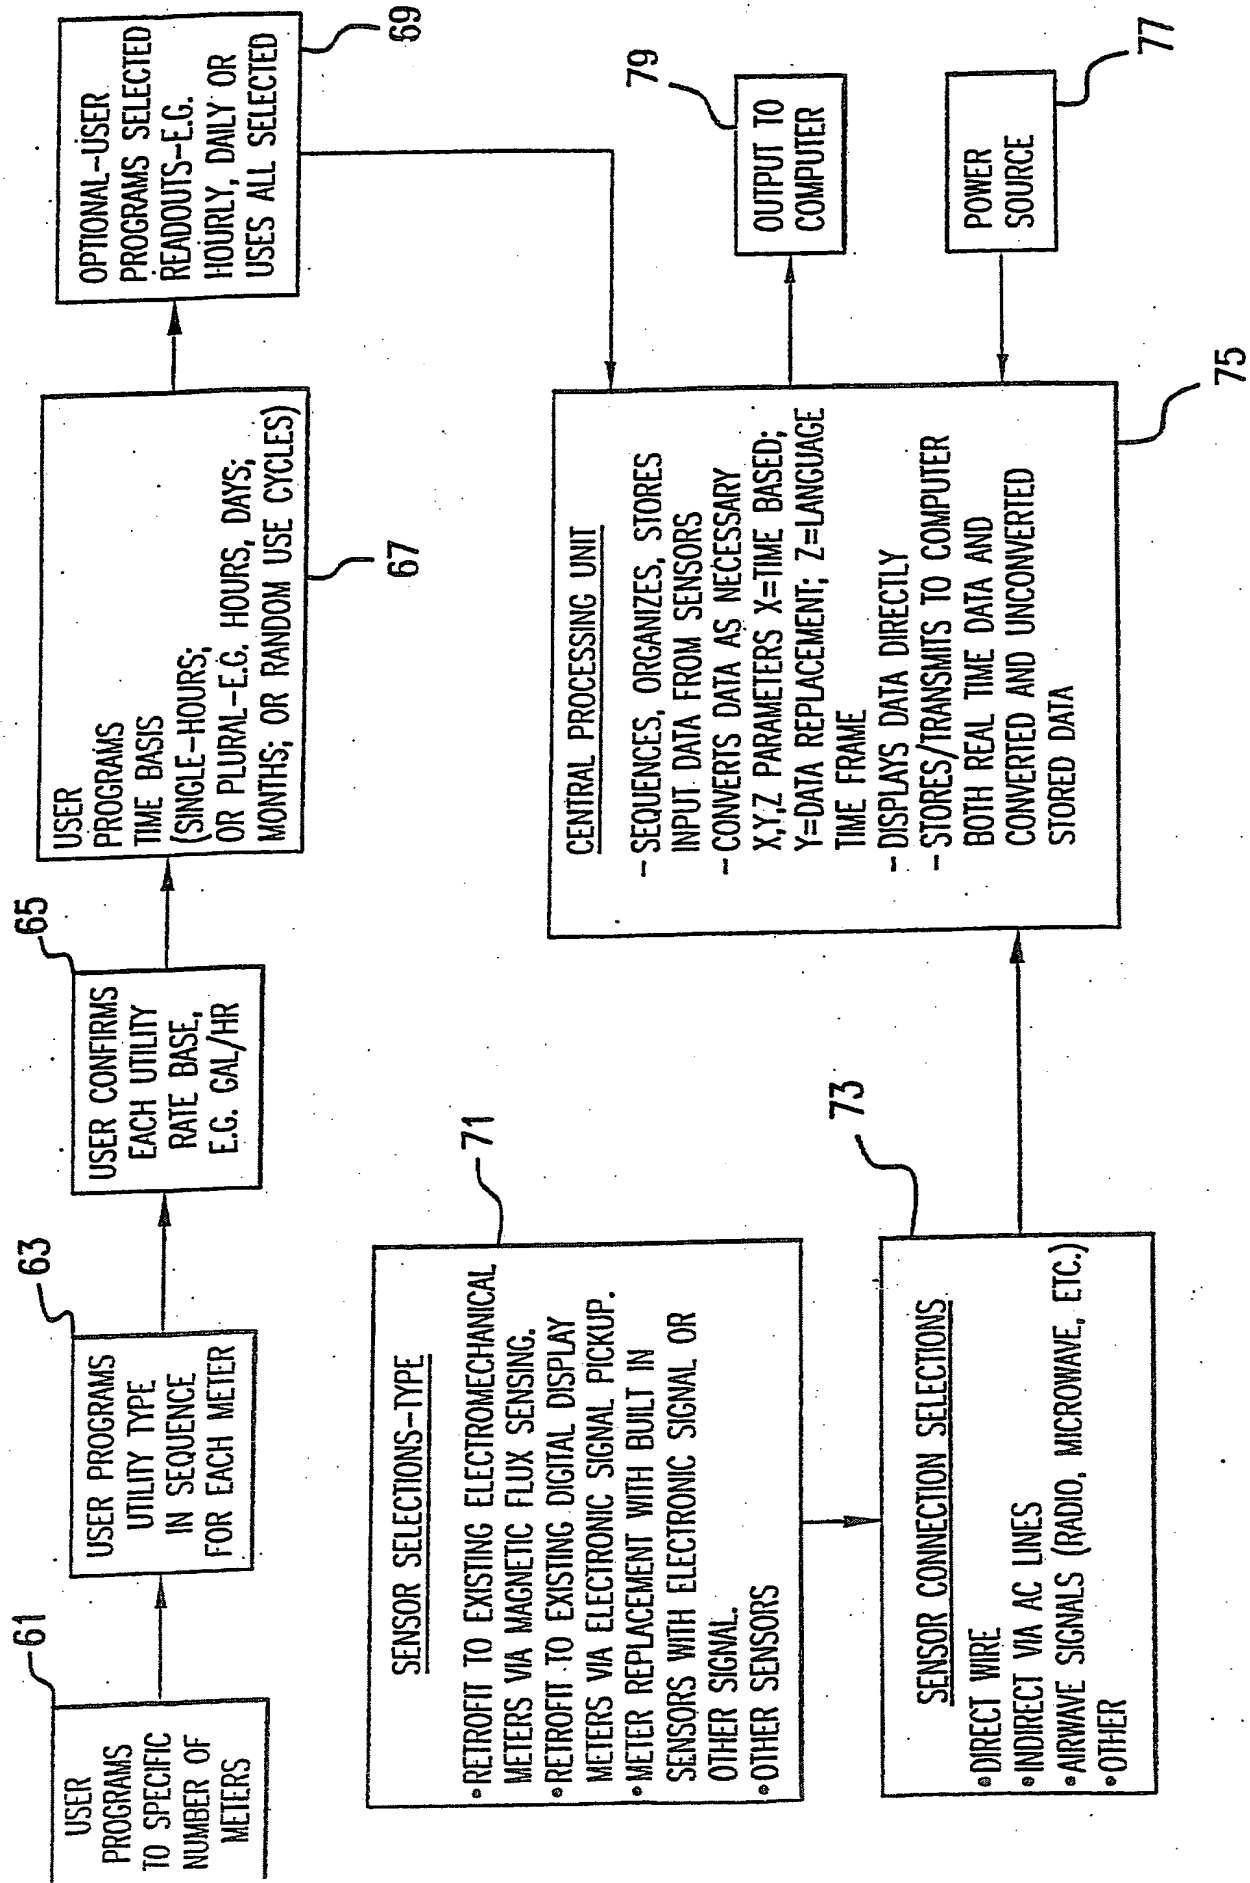


FIG.3


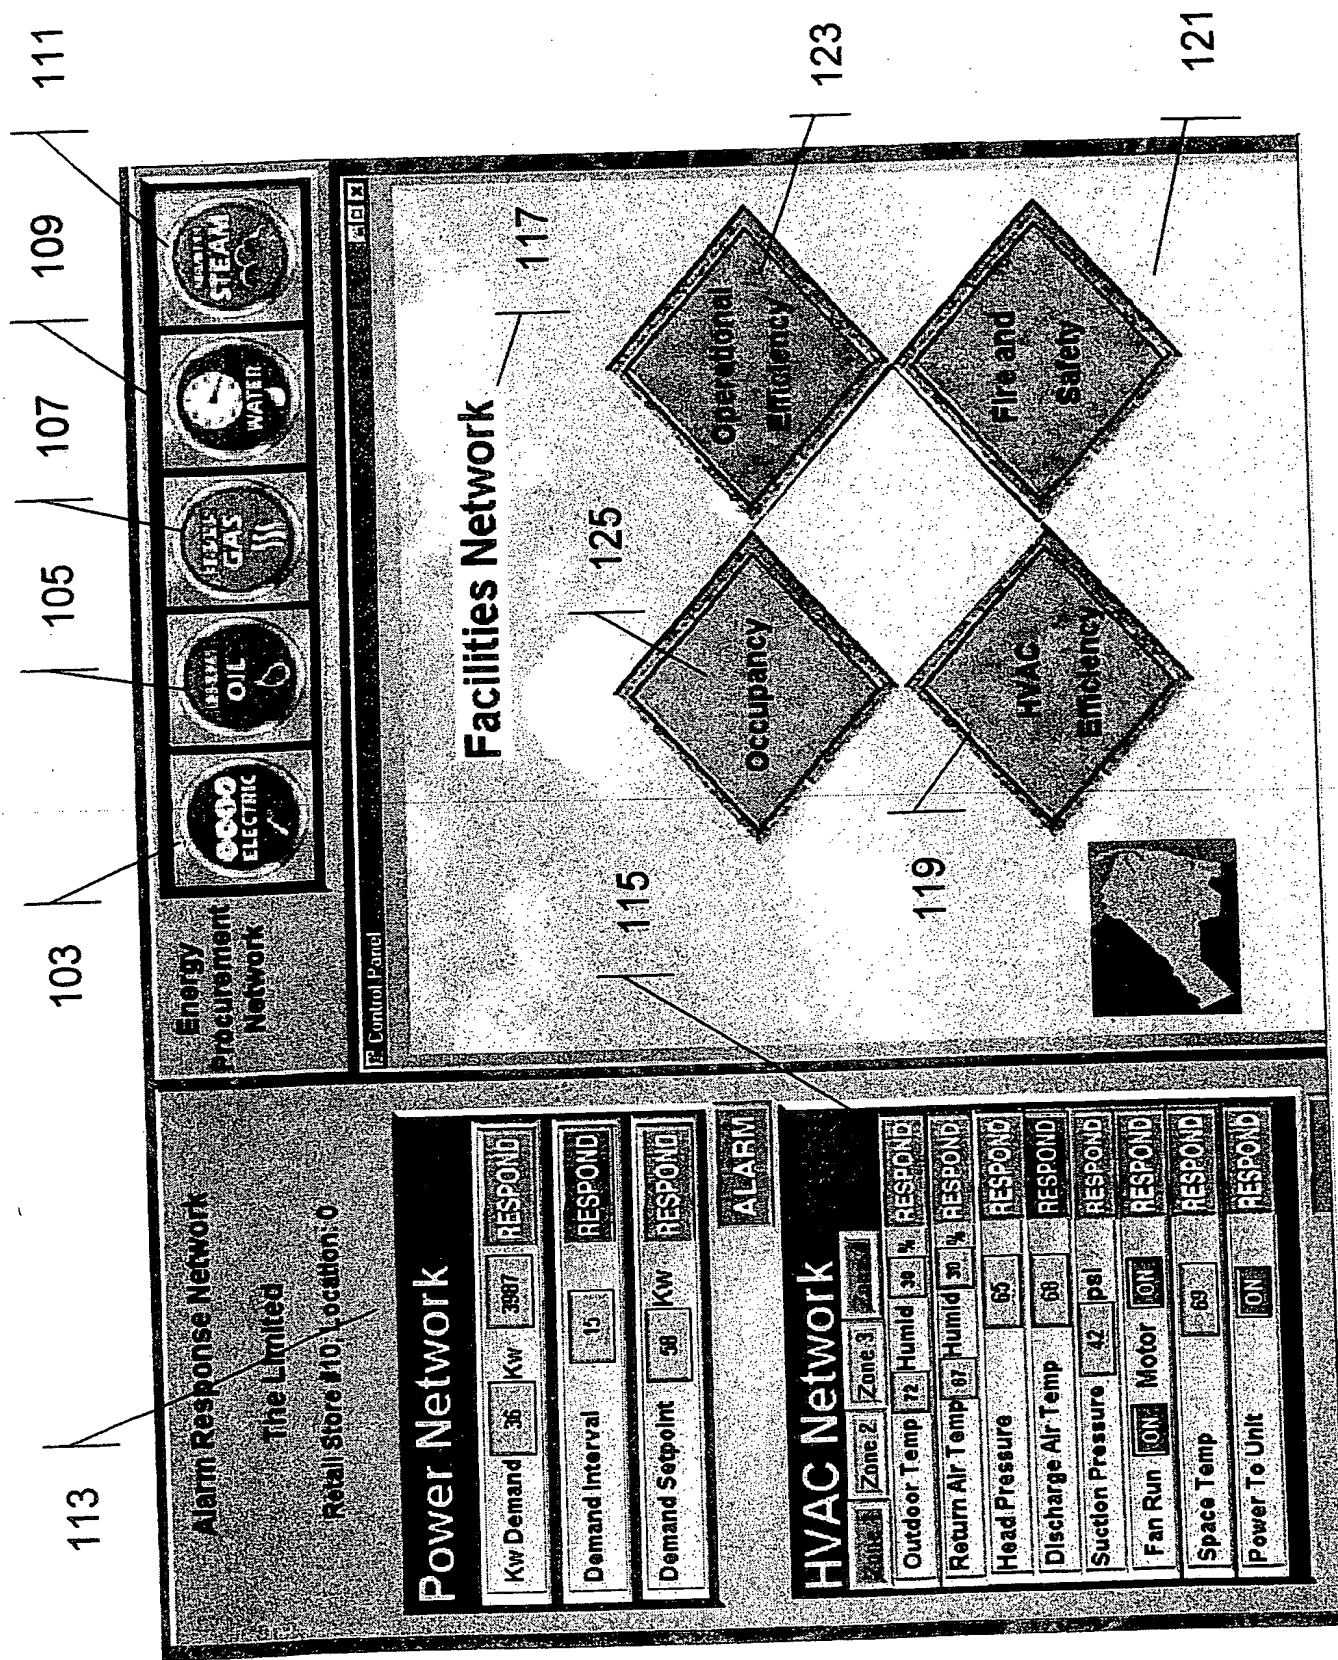


Figure 4

Real Time Electric Consumption and Energy Cost Analysis For



Provider: Public Service Electric and Gas

Price per Kwh = 9.5 Cents

Total Consumption Today

\$44.55 for 469 Kw

Price Off Peak Kwh = .07 cents...\$275

Price On Peak Kwh = .09 cents...\$575

Demand Penalty = \$100.00


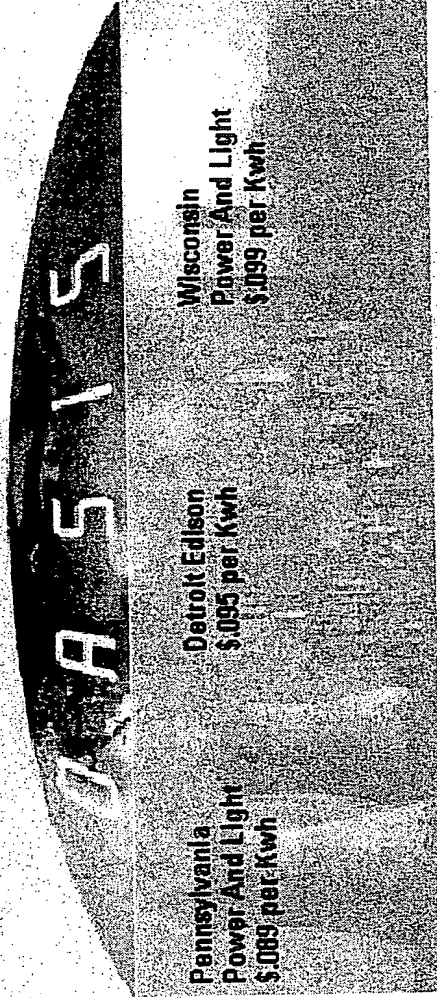


Figure 5



OASIS Nodes in MAAC

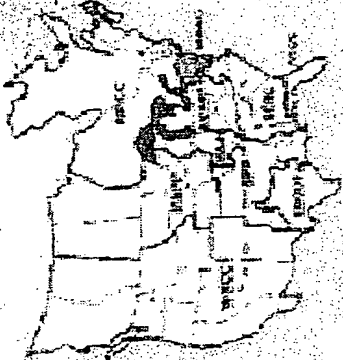


Node:
PJM OASIS

<http://oasis.pjm.com>

Providers on PJM OASIS	
Provider Code	Provider Name
AE	Atlantic City Electric Company
EGE	Baltimore Gas and Electric Company
DPL	Delmarva Power and Light Company
GPU	GPU Energy
PECO	PECO Energy Company
PPL	Pennsylvania Power and Light Company
PEPC	Potomac Electric Power Company (PEPCO)
PJM	PJM
PSEG	Public Service Electric and Gas Company

Figure 6



Occupancy

RETURN

OUTSIDE INFORMATION

Of People Who Passed The Front Door/Gate 236

Approximate Time That These People Walked By

8:00 AM to 10:30 AM	24	3:30 PM to 5:00 PM	144
10:30 AM to 1:00 PM	14	5:00 PM to 7:30 PM	26
1:00 PM to 3:30 PM	58	7:30 PM to 10:00 PM	179

INSIDE INFORMATION

Of People Who Entered The Front Door/Gate 46

Approximate Time That These People Walked In

8:00 AM to 10:30 AM	13	3:30 PM to 5:00 PM	29
10:30 AM to 1:00 PM	24	5:00 PM to 7:30 PM	13
1:00 PM to 3:30 PM	16	7:30 PM to 10:00 PM	88

211

Figure 7

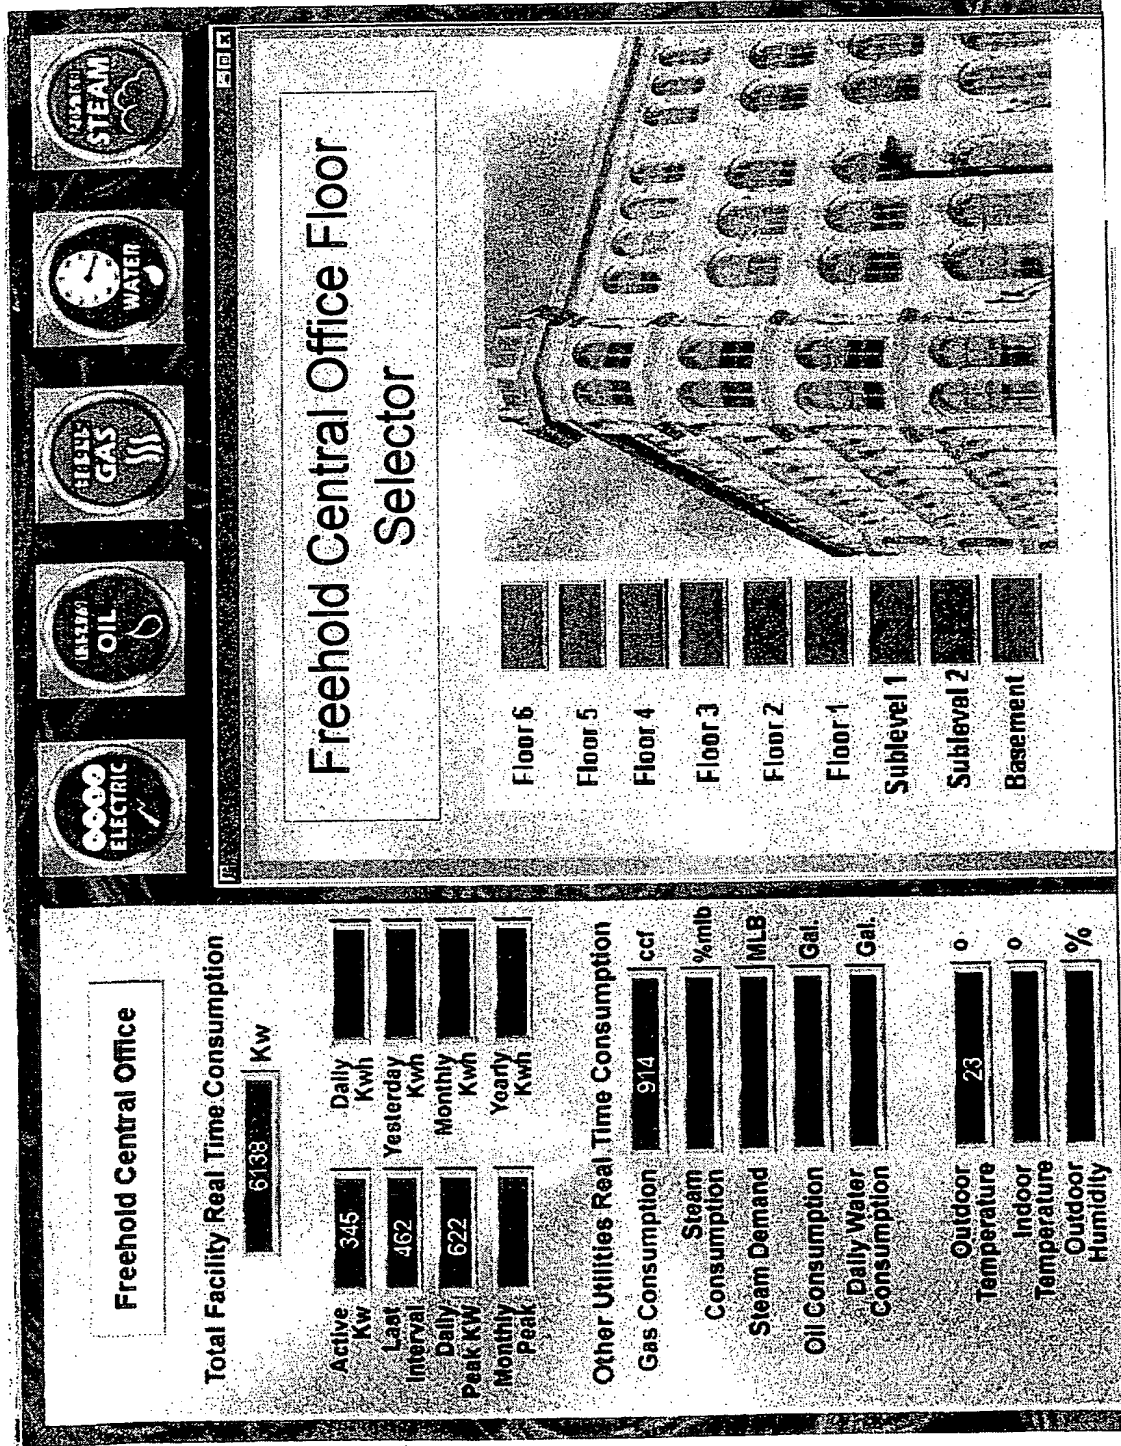


Figure 8

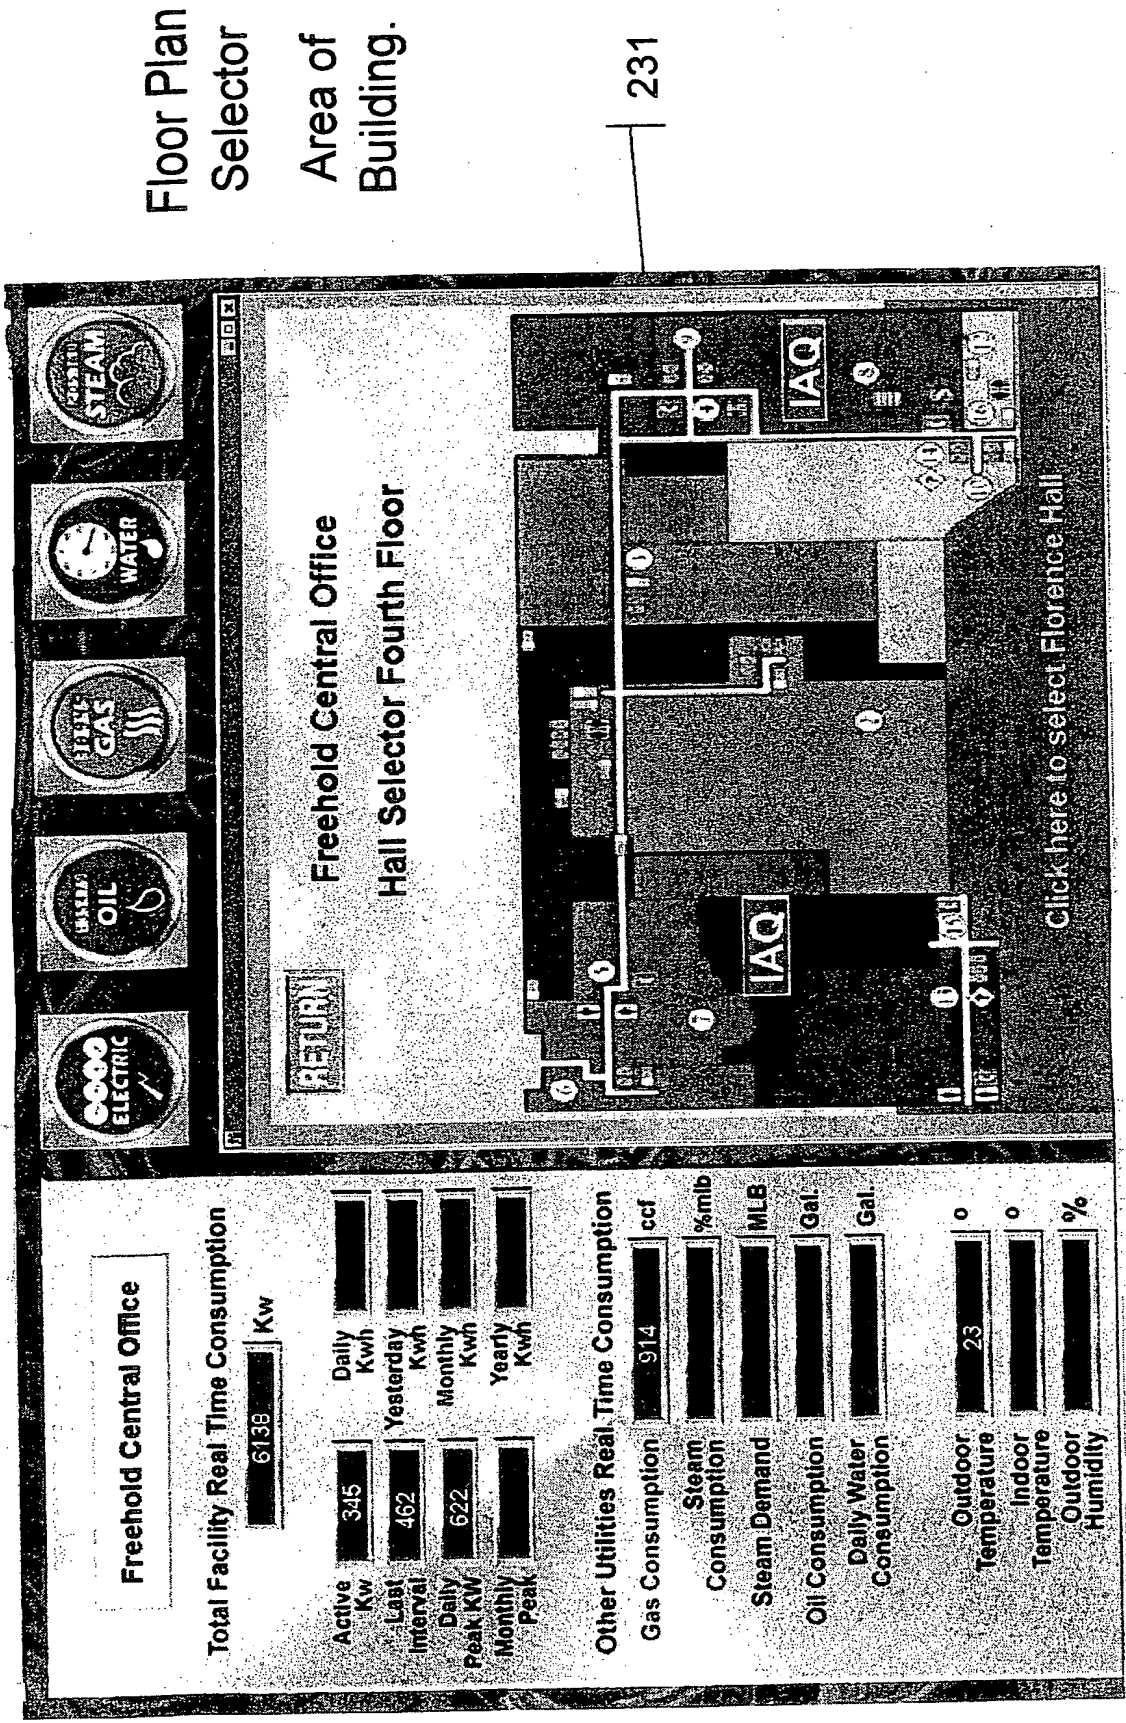


Figure 9

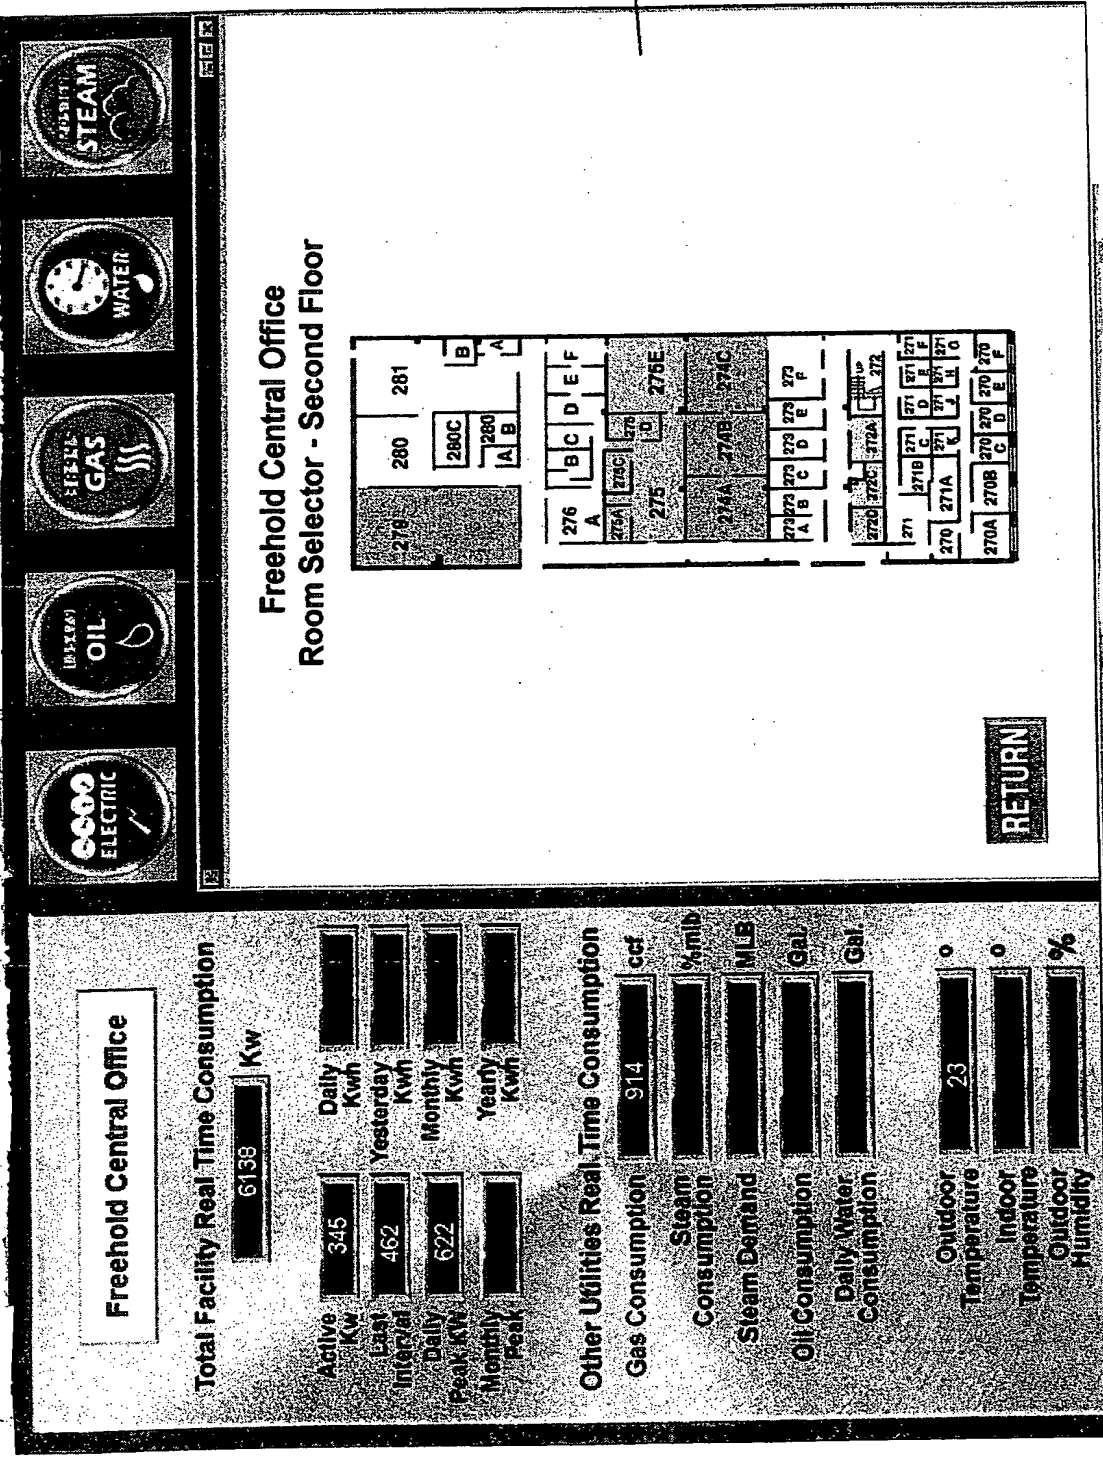


Figure 10



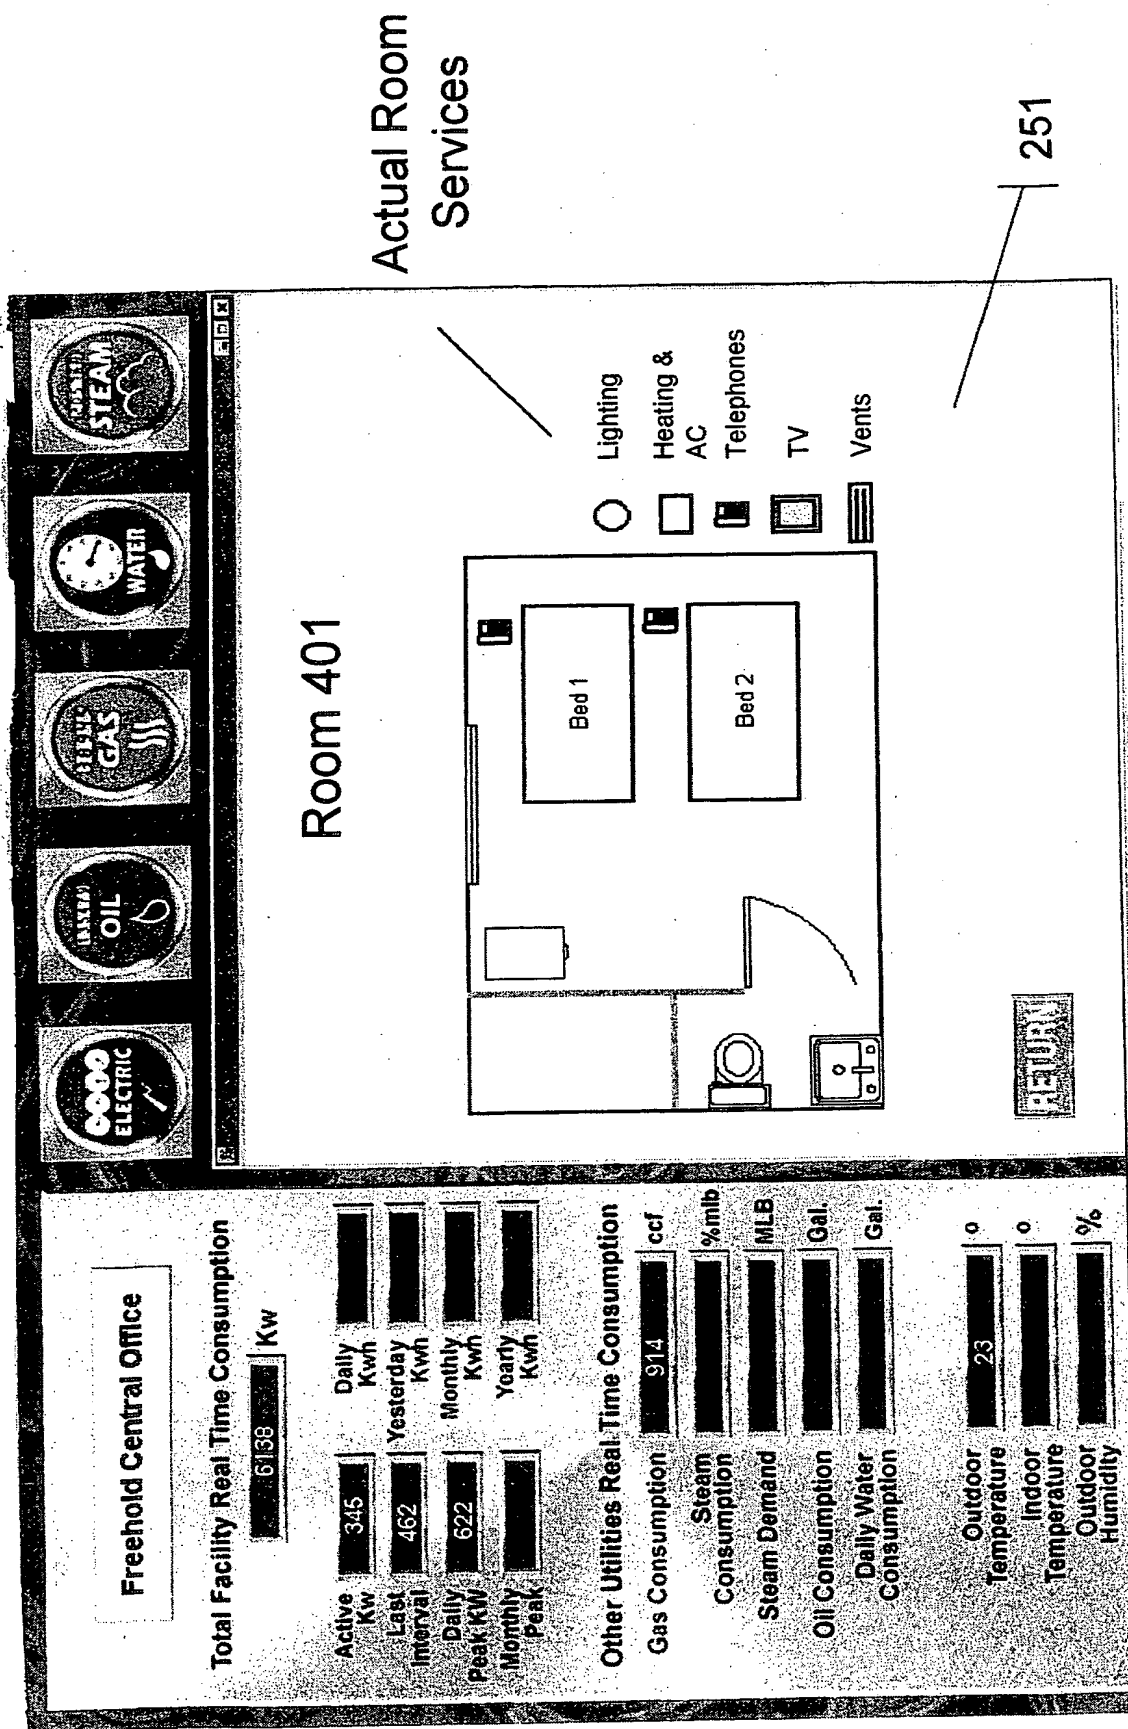


Figure 11


Electric Adaptive Demand Center




HVAC Load #2

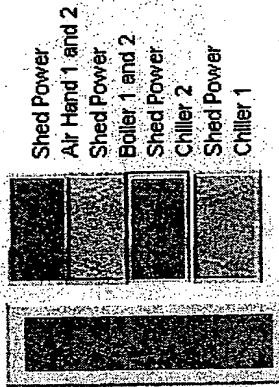

HVAC Load #1

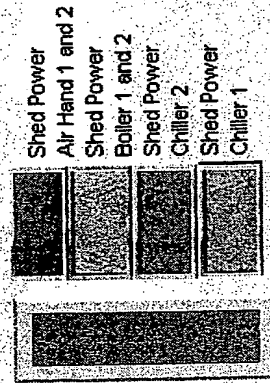

HVAC Load #4

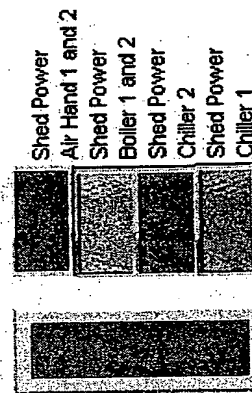

HVAC Load #3

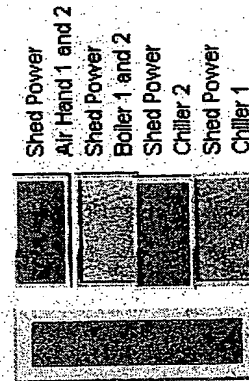


Figure 12

HVAC Efficiency

RETURN

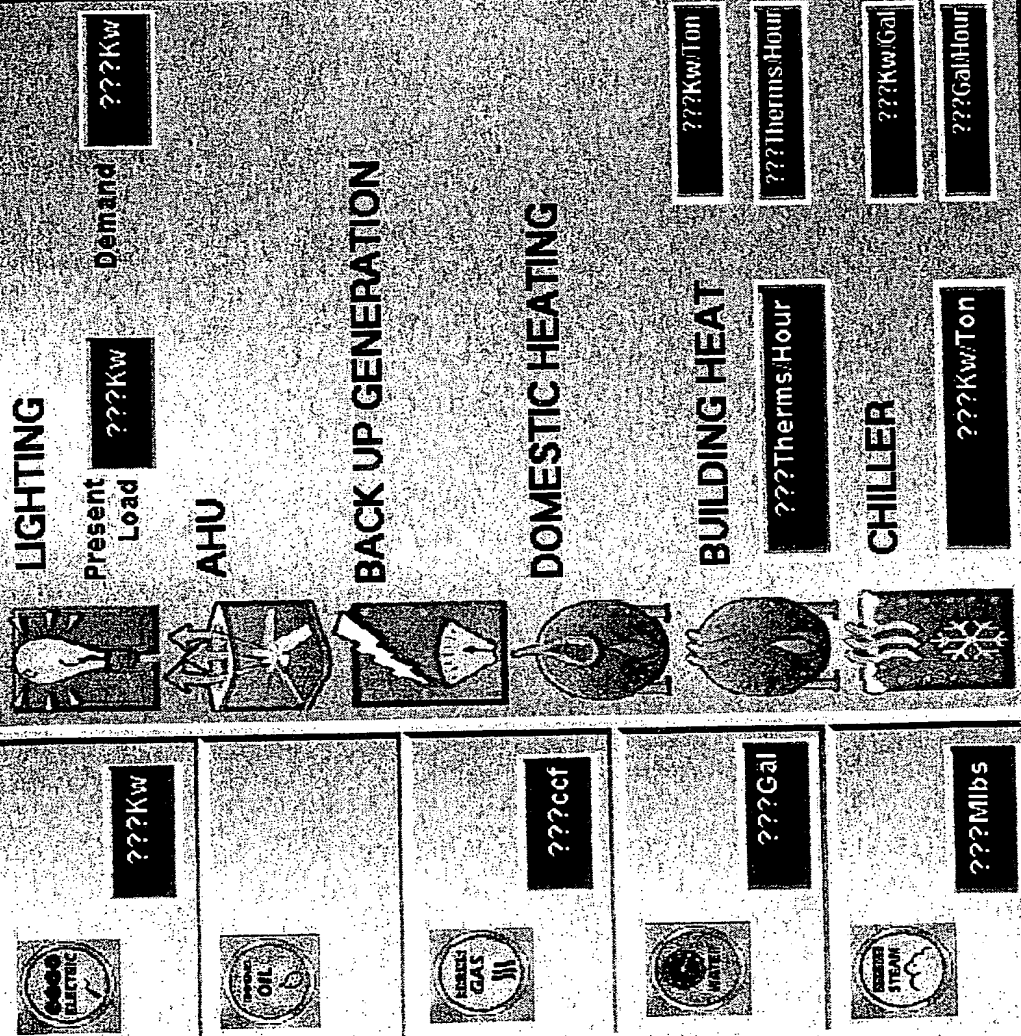


Figure 13


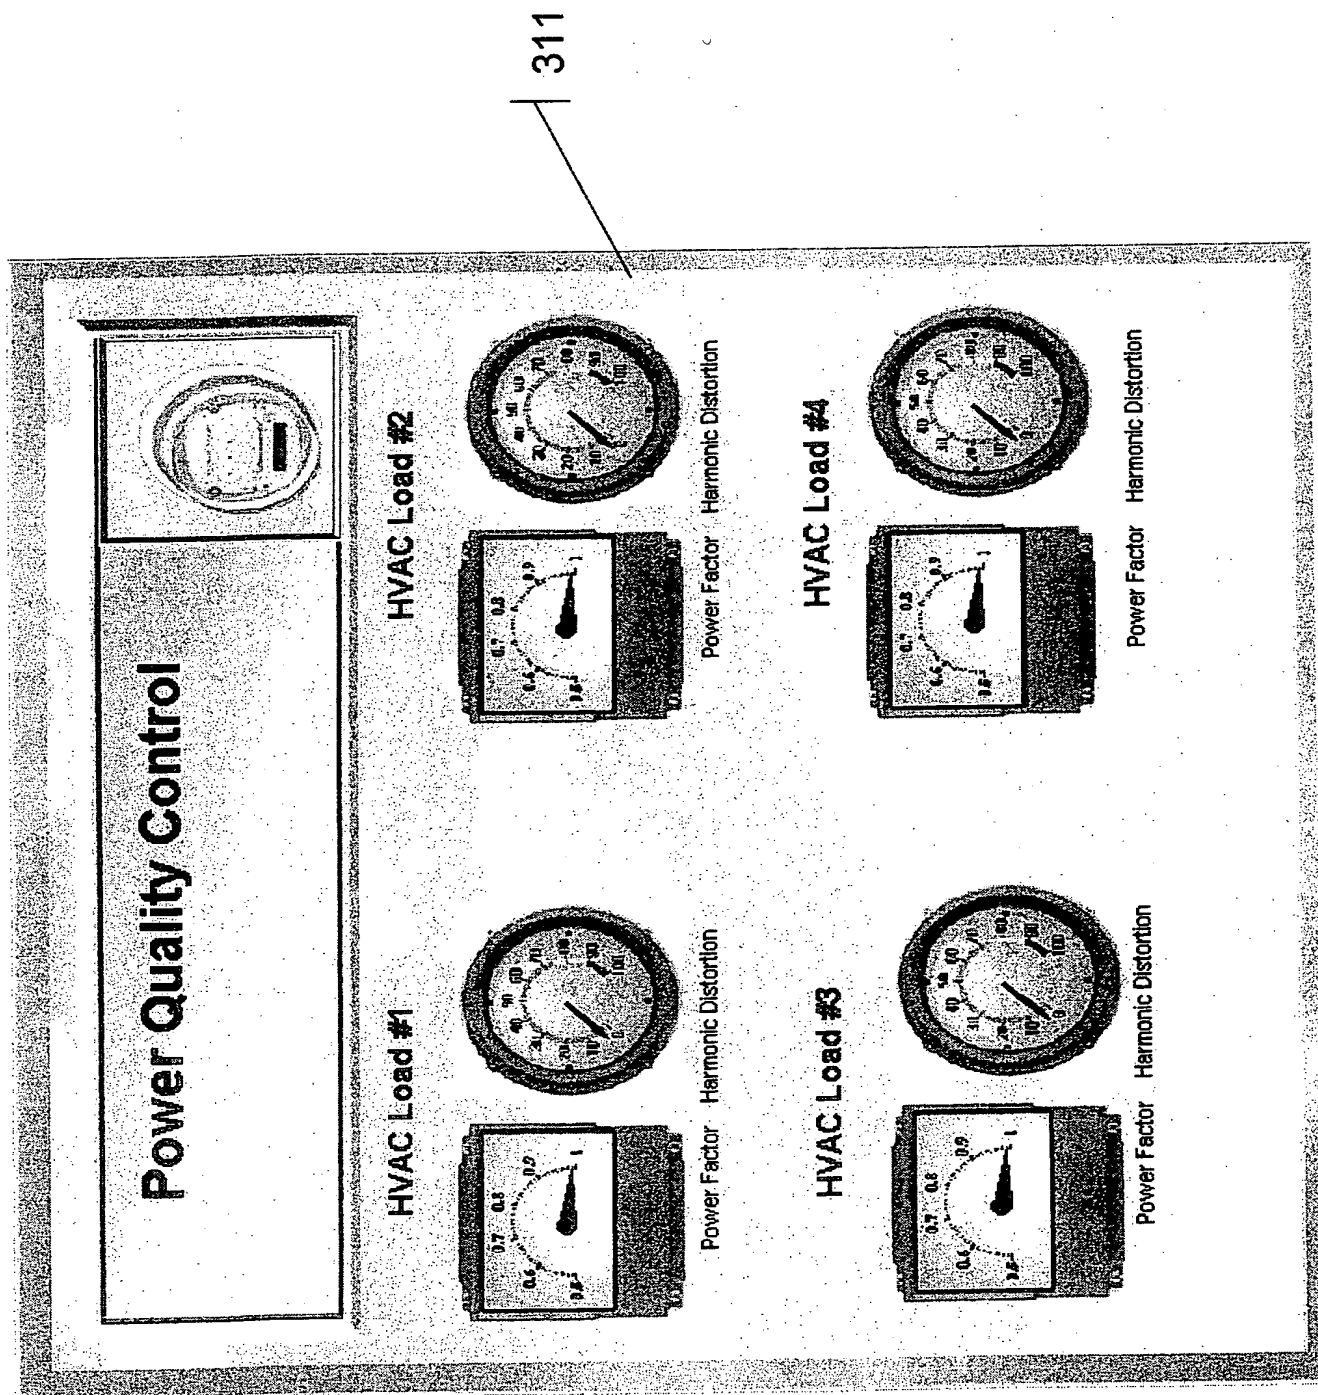


Figure 14

Indoor Air Quality Room Selector for Fourth Floor

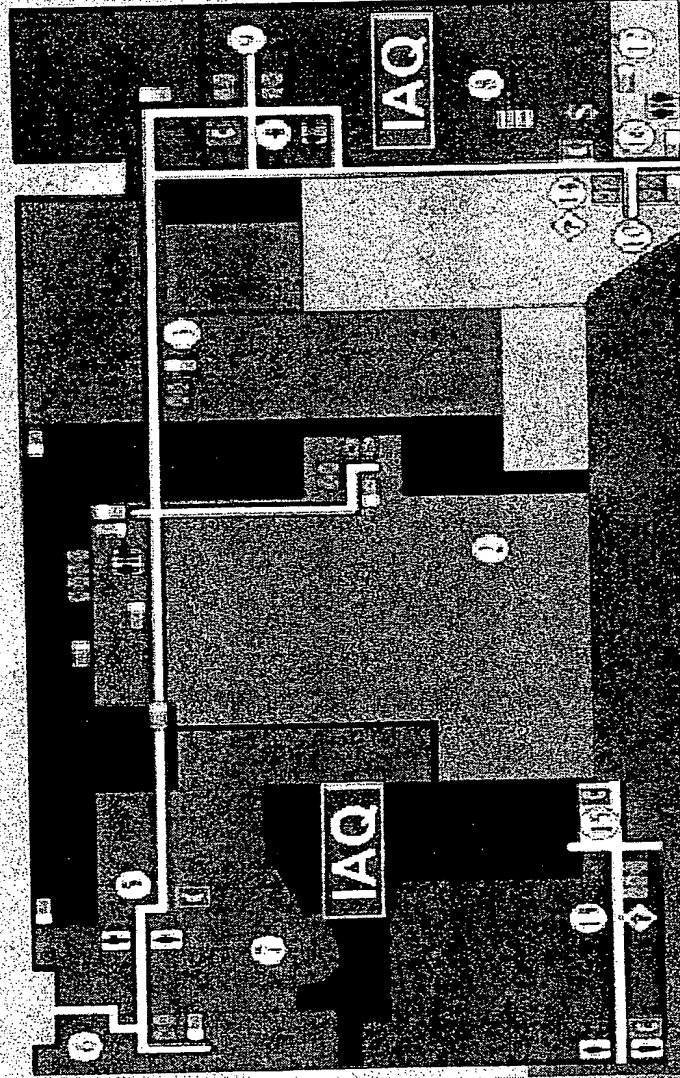


Please Select a Room

RETURN

321

Figure 15



Indoor Air Quality

RETURN

Level Detected Acceptable

SO ₂ - Sulfur Dioxide =	0.2 ppm	0.14 ppm
H ₂ S	0 ppm	0.14 ppm
CO ₂ - Carbon Dioxide	1500 ppm	1000 ppm
CO - Carbon Monoxide	1 ppm	2.5 ppm
NO - Nitrous Oxide	37.2 ppm	0.4 p pm
NO ₂ - Nitrogen Dioxide	0.7 ppm	0.3 ppm
VOCs - Volatile Organic Compounds	High	Medium
RH - Relative Humidity	44% - 58.4%	
Temp -	°	

331

Figure 16

Location of
Multisite
Location


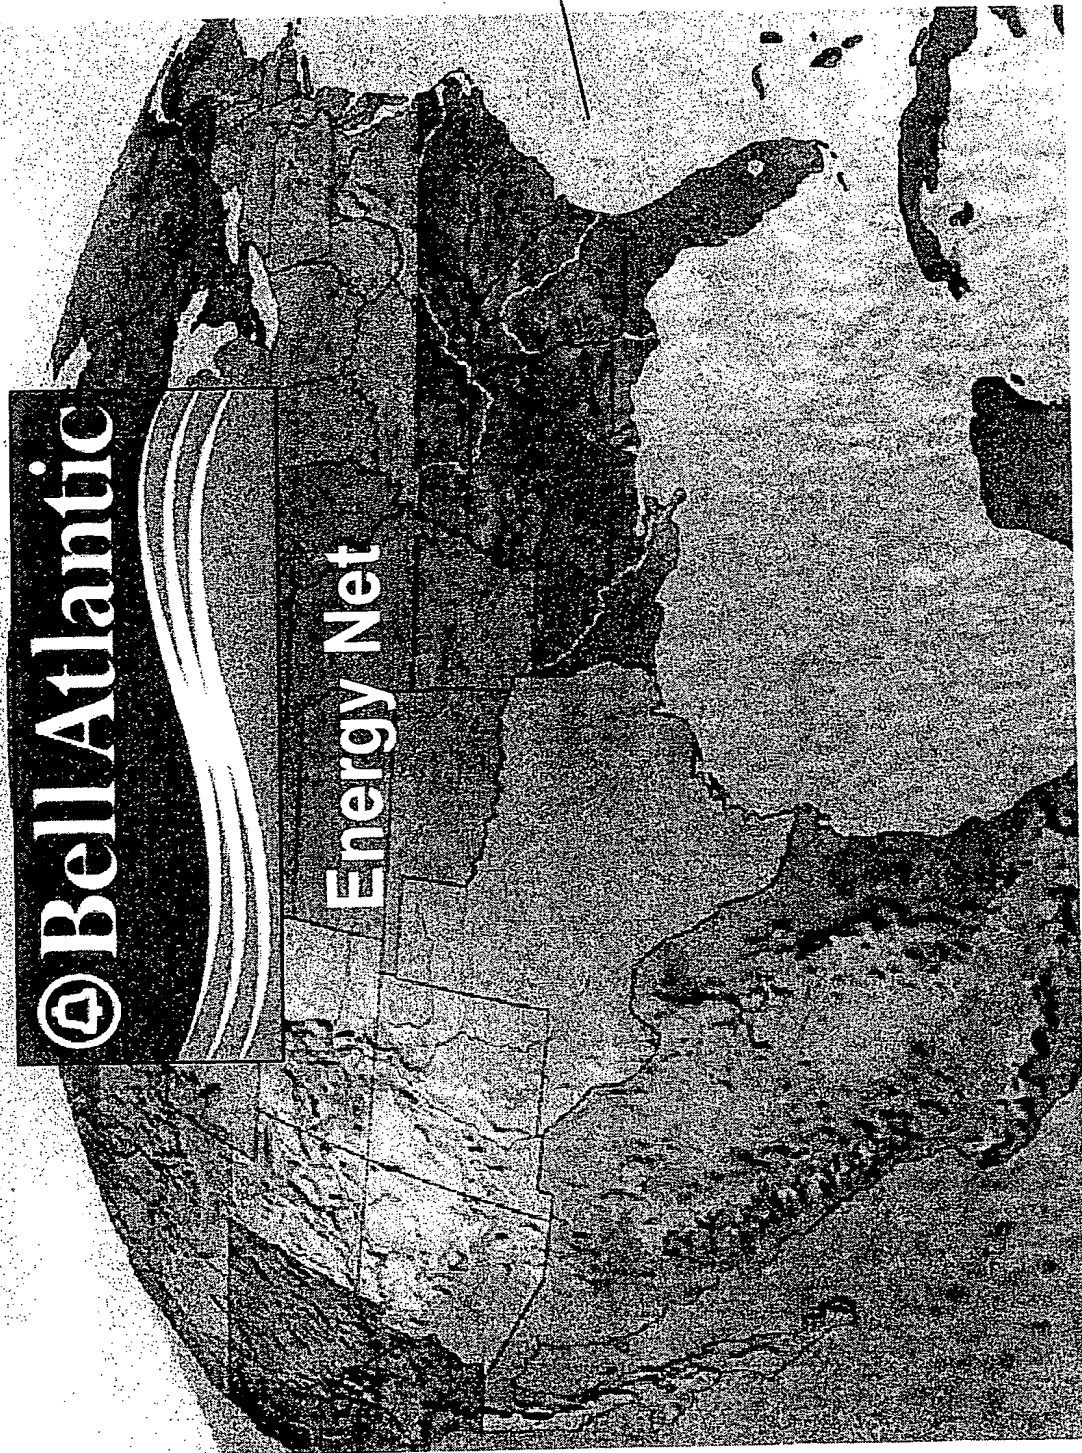


Figure 17

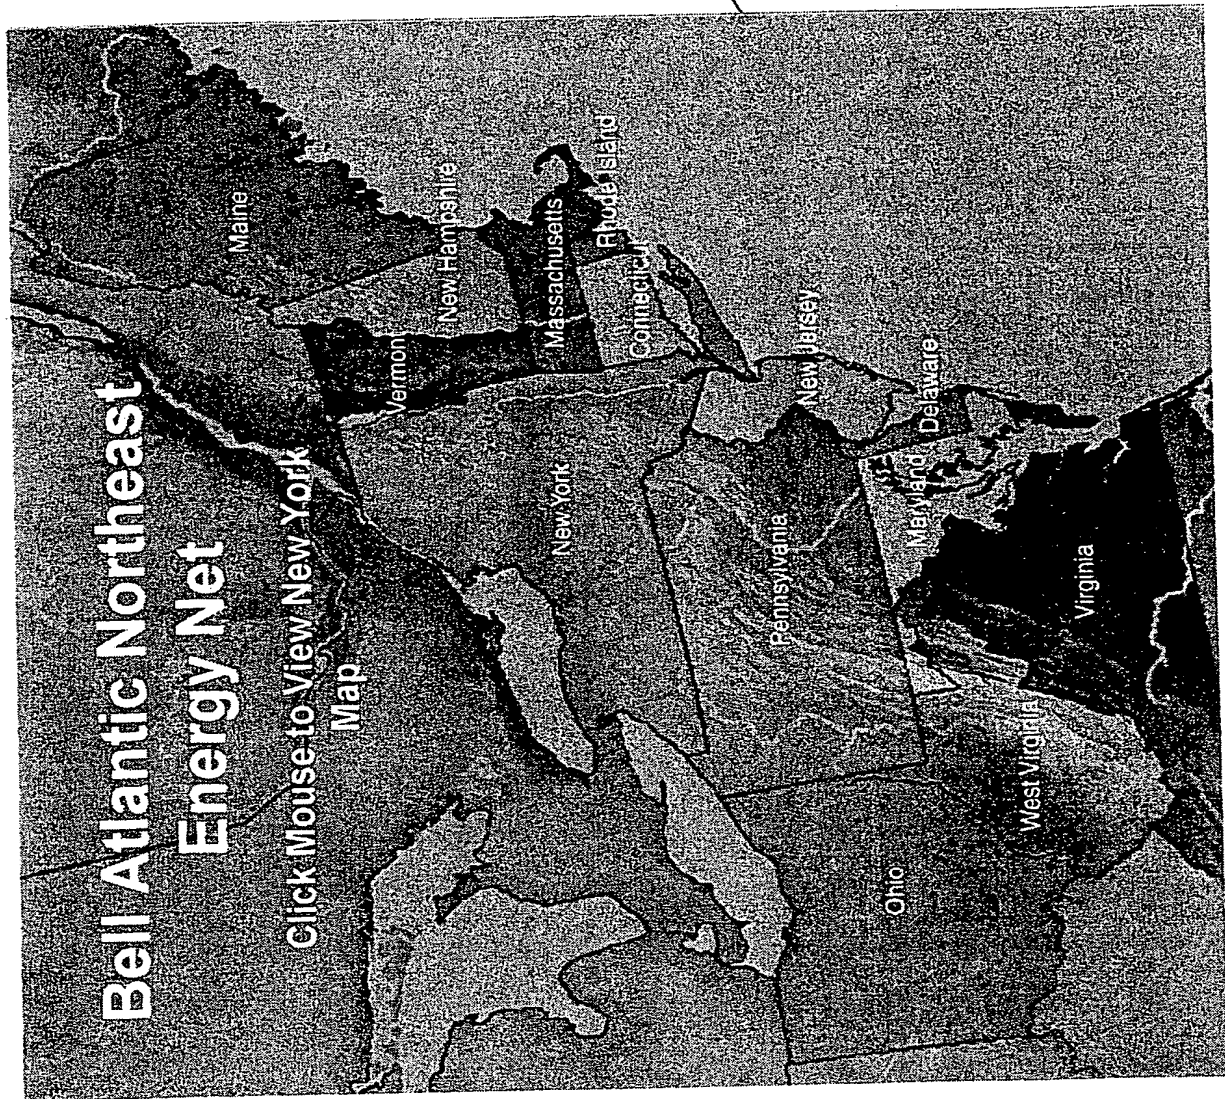

Location
Maps

371

Figure 18


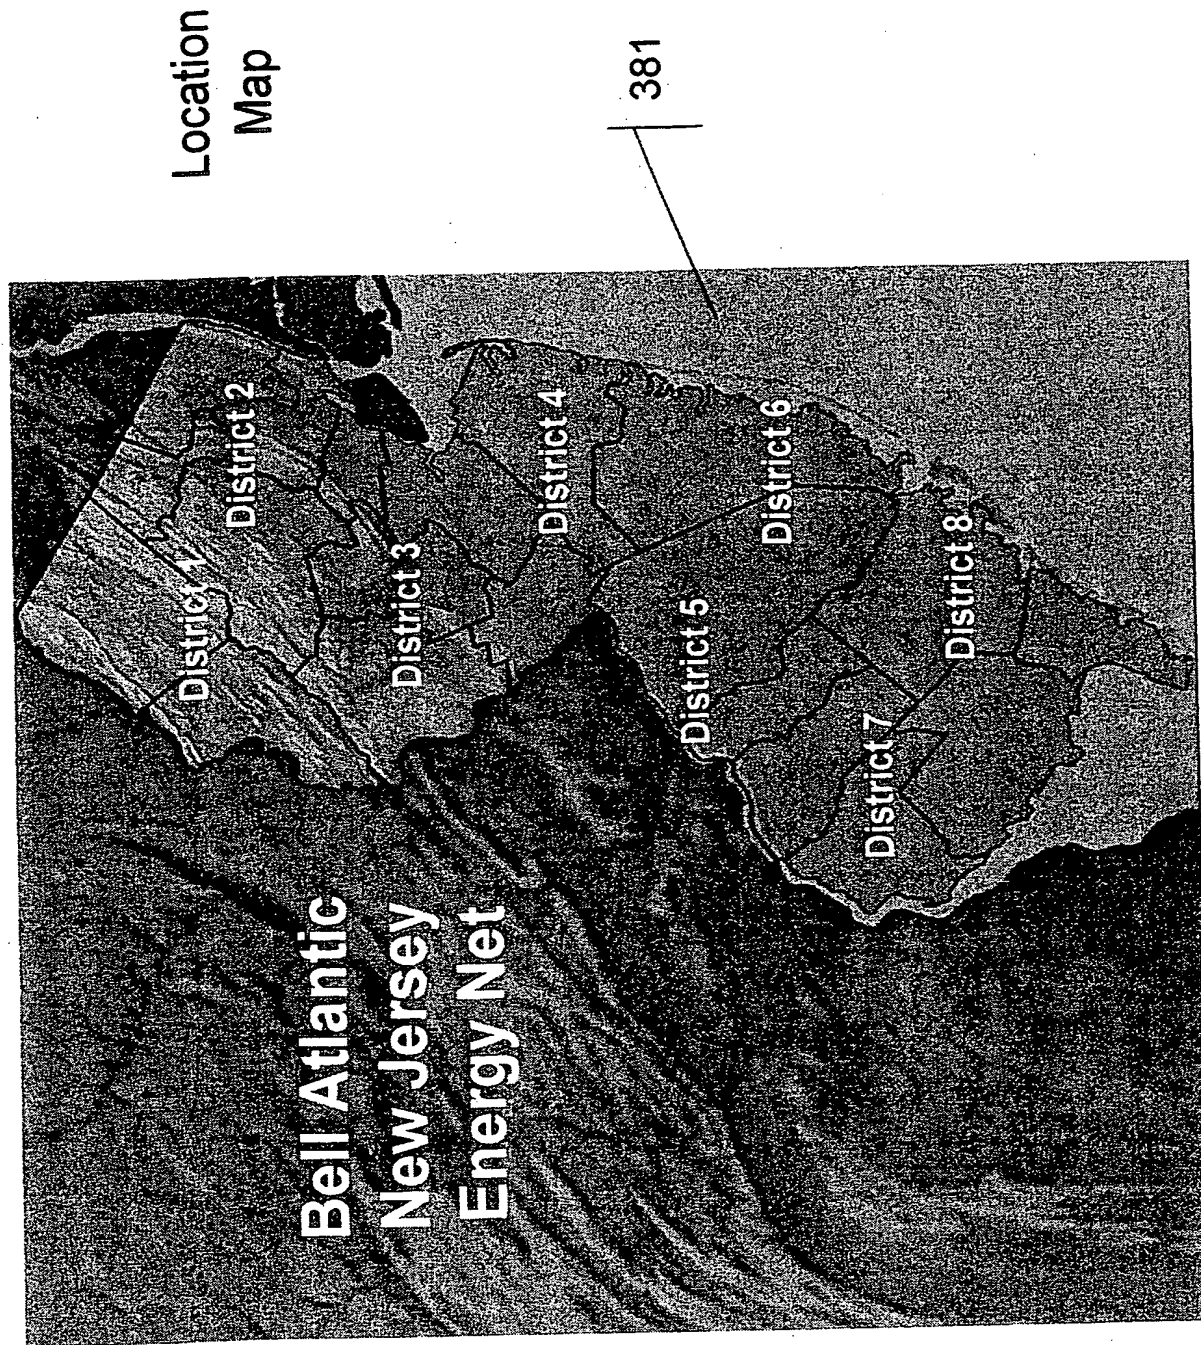


Figure 19

New Jersey Energy Net District 4

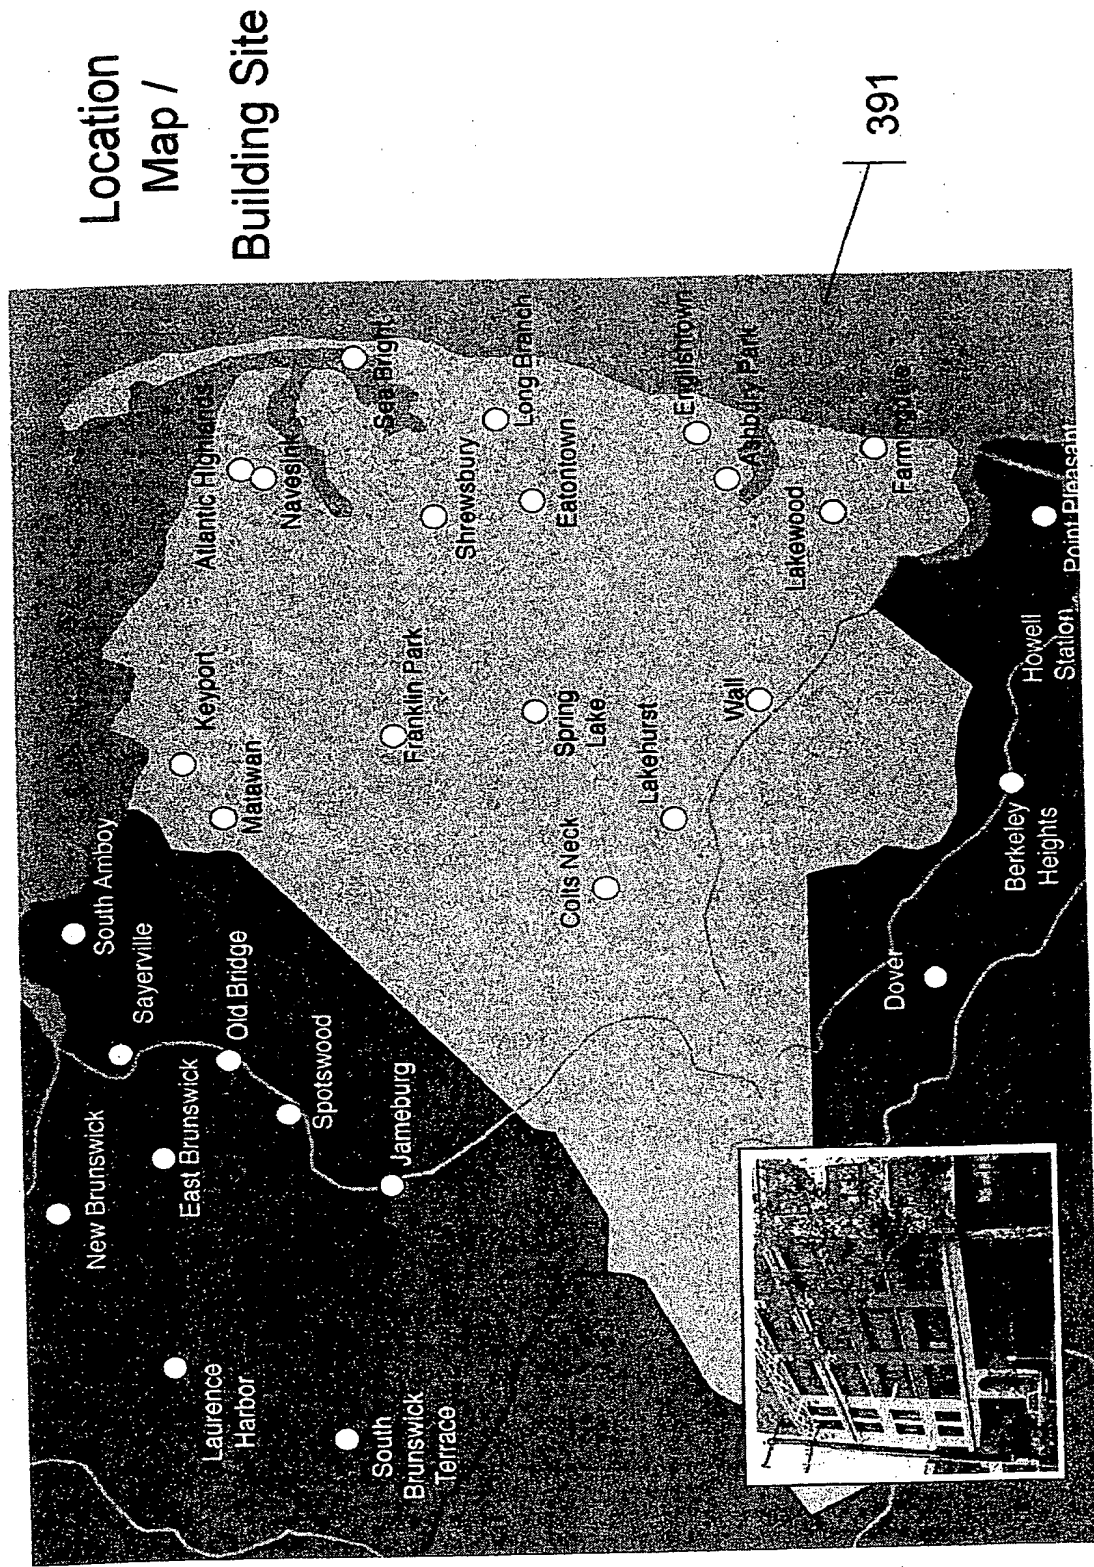


Location
Map /

Building Site

Figure 20

Location of Building for Campus, University & Hospital Locations

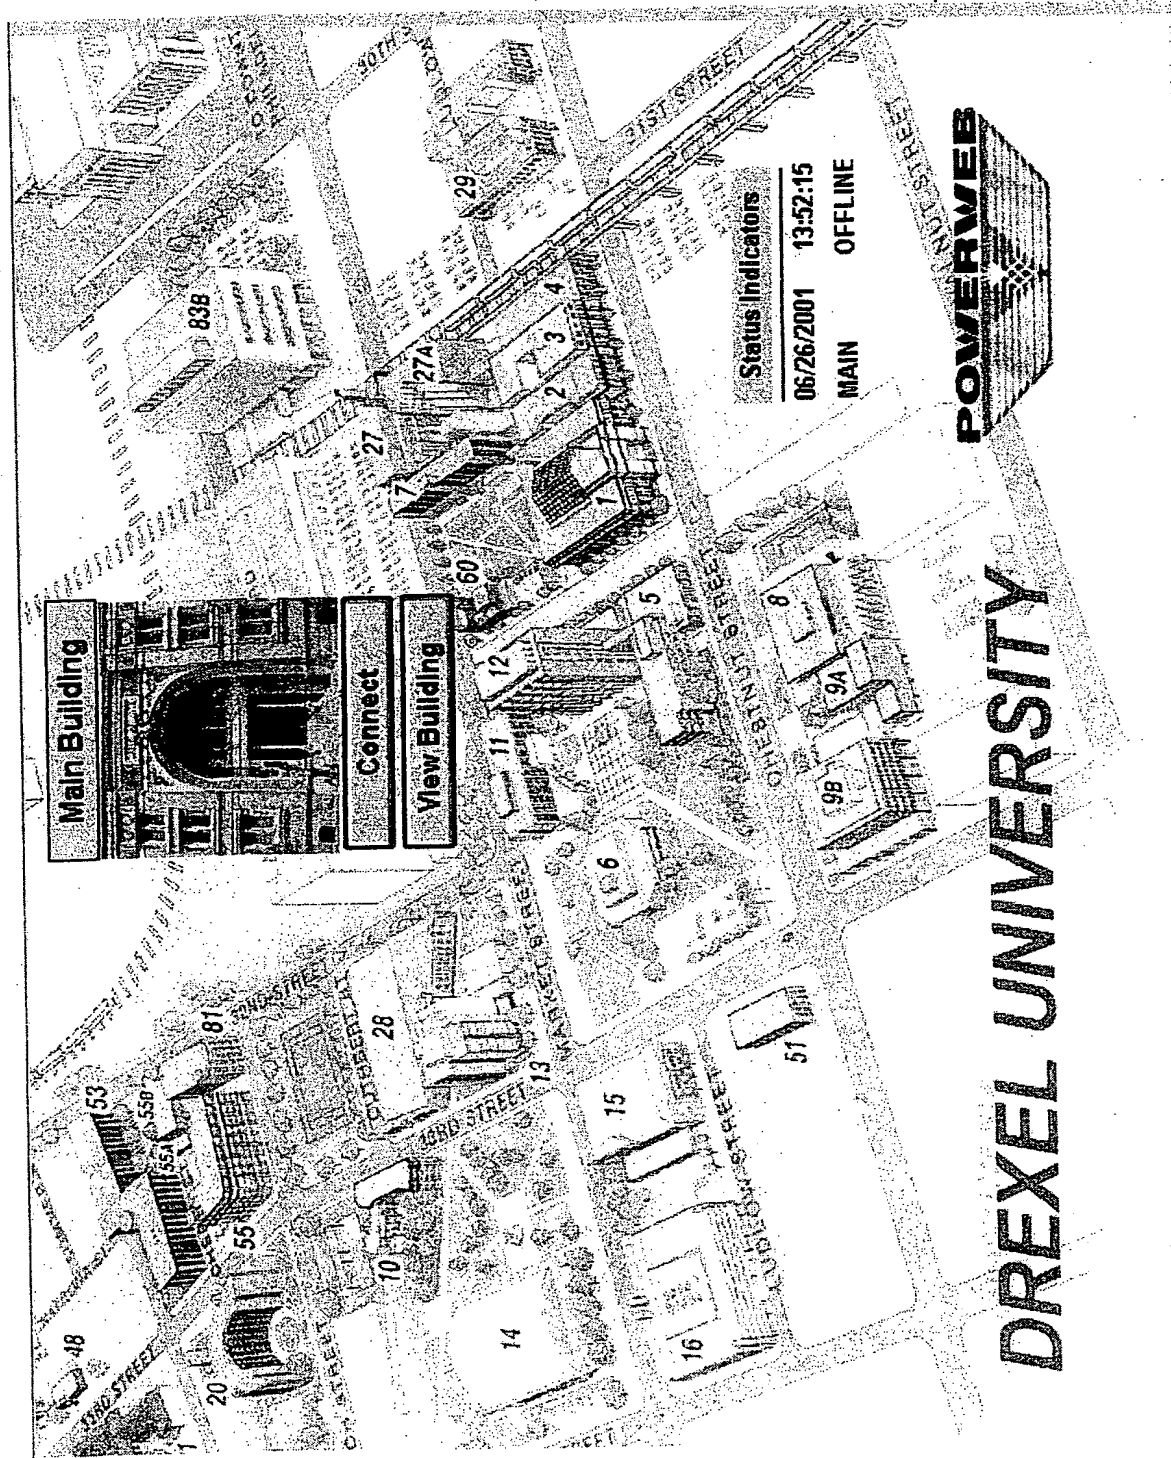

401

Figure 21


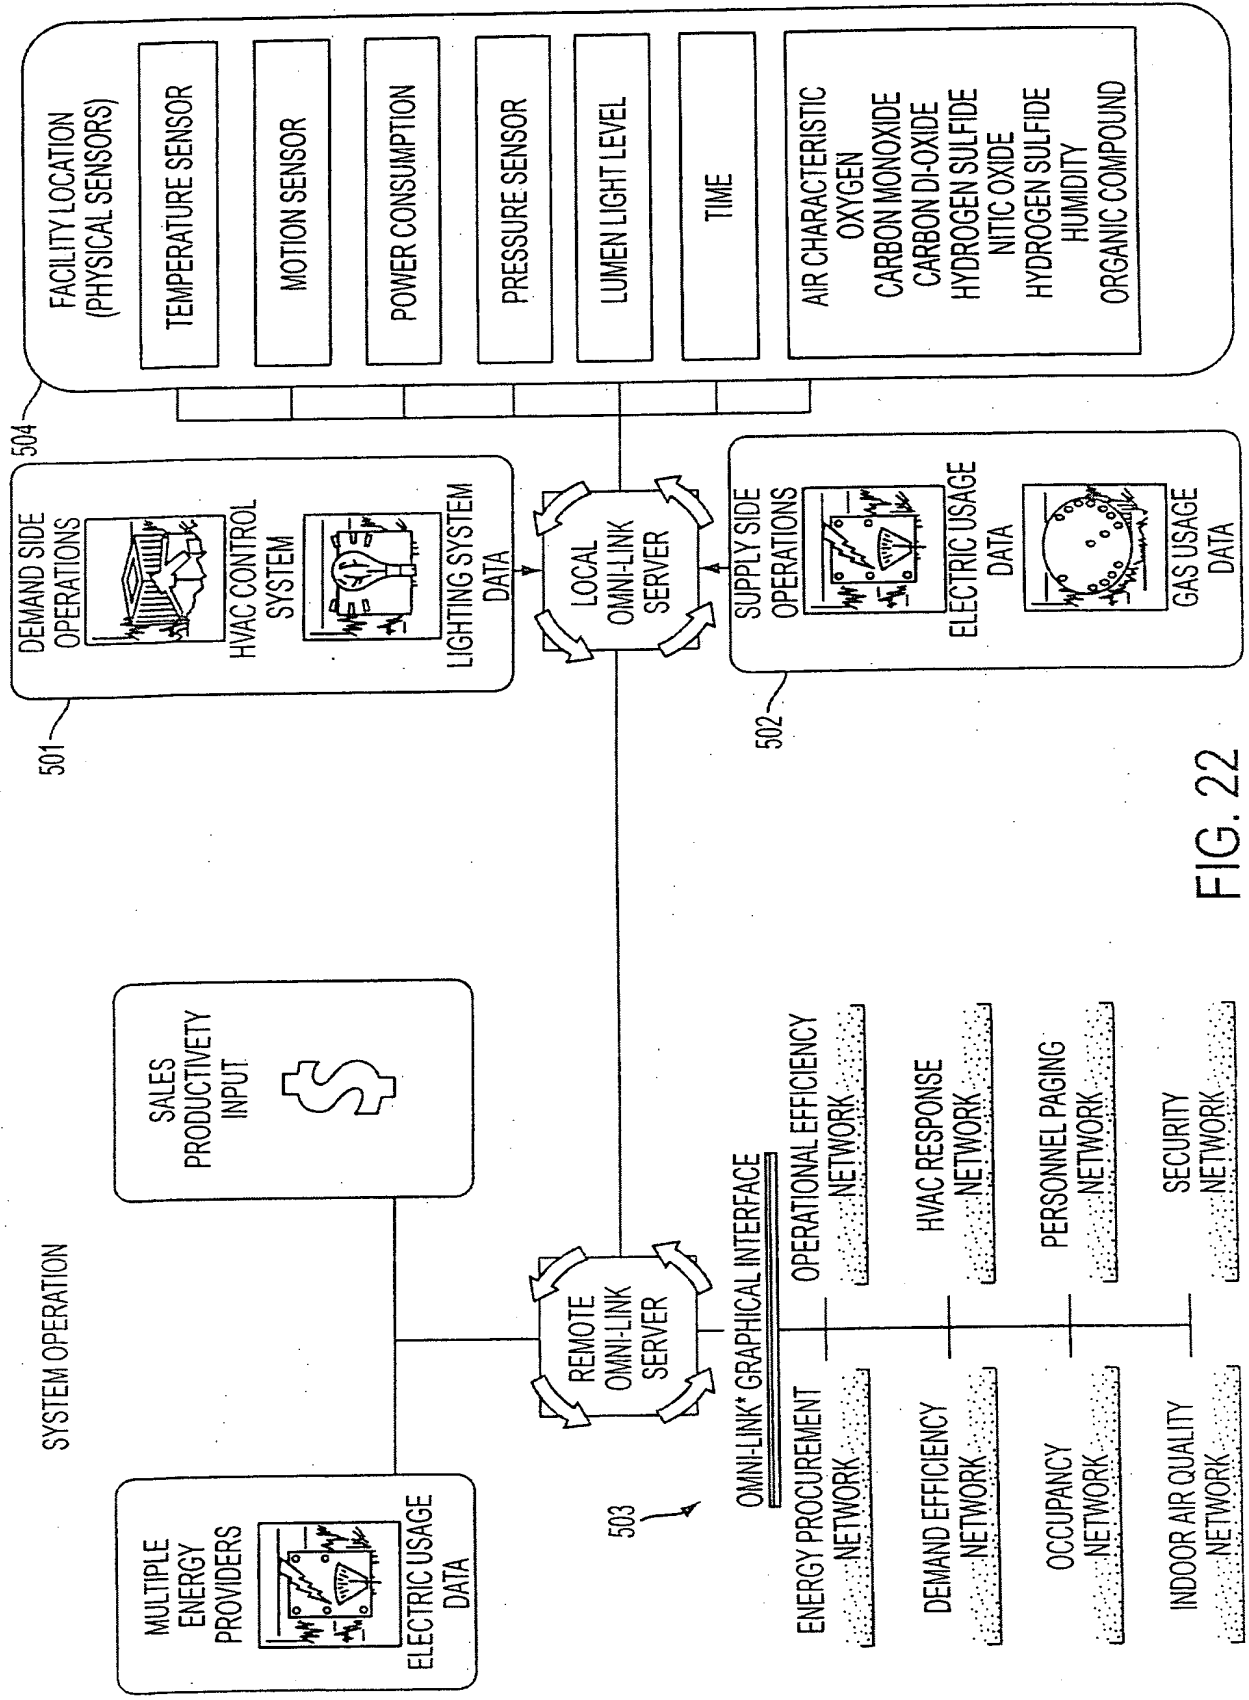


FIG. 22

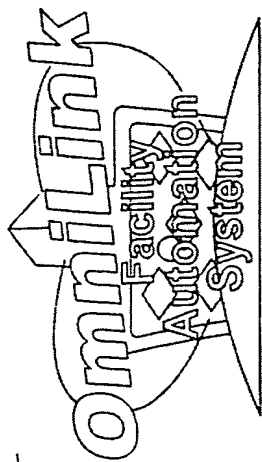

DEMAND
EFFICIENCY
NETWORK

NET BENEFITS:

- CENTRALIZED DEMAND CONTROL
- LOCALIZED DEMAND CONTROL
- UTILITY PROCUREMENT DEMAND CONTROL
- CORPORATE DEMAND PROFILING
- PINPOINT PROBLEM AREAS

NET SAVINGS:

- CONSERVATIVELY A 3-10% REDUCTION IN ELECTRICAL DEMAND


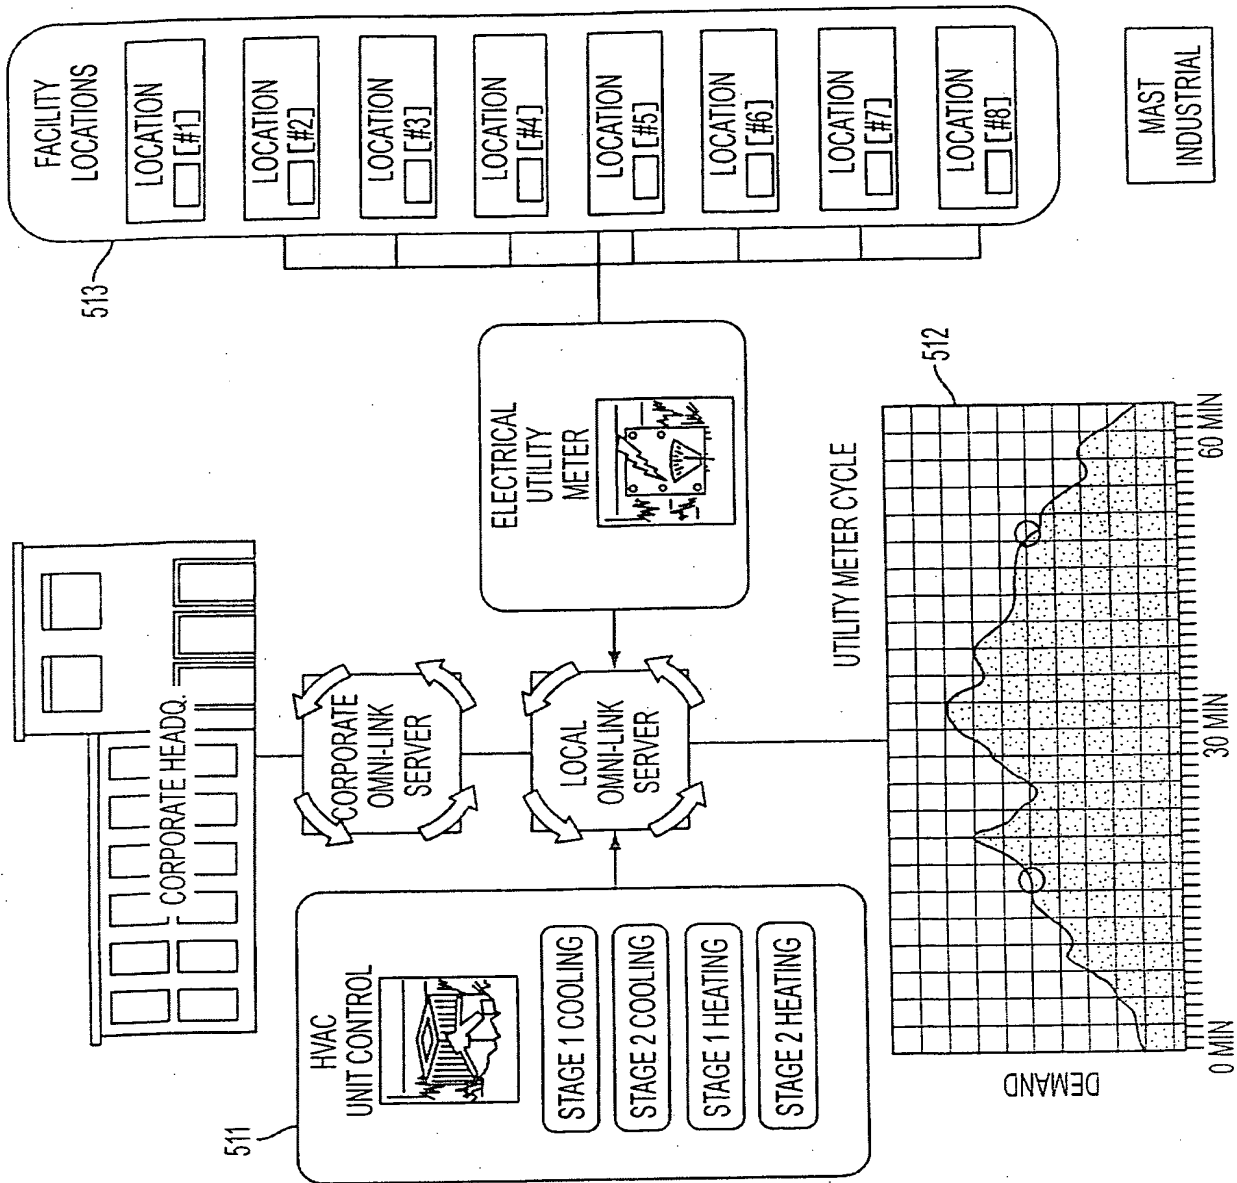


FIG. 23

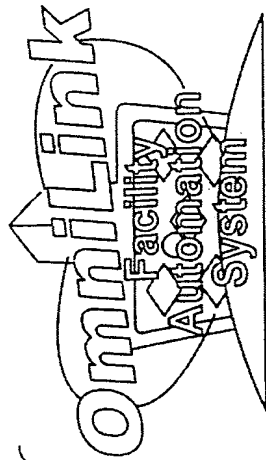

OPERATIONAL
EFFICIENCY
NETWORK

NET BENEFITS:

- NATIONWIDE SIMULTANEOUS OPERATIONAL CONTROL
- EFFICIENT OPERATIONS OF HVAC & LIGHTING
- TIMECLOCK EFFICIENCY WITHOUT HUMAN INTERVENTION
- AUTOMATIC SPACE PRE-HEAT/ PRE-COOL
- AUTOMATIC MULTI-STAGE LIGHTING

NET SAVINGS:

- CONSERVATIVELY 5-15% REDUCTION IN ENERGY CONSUMPTION


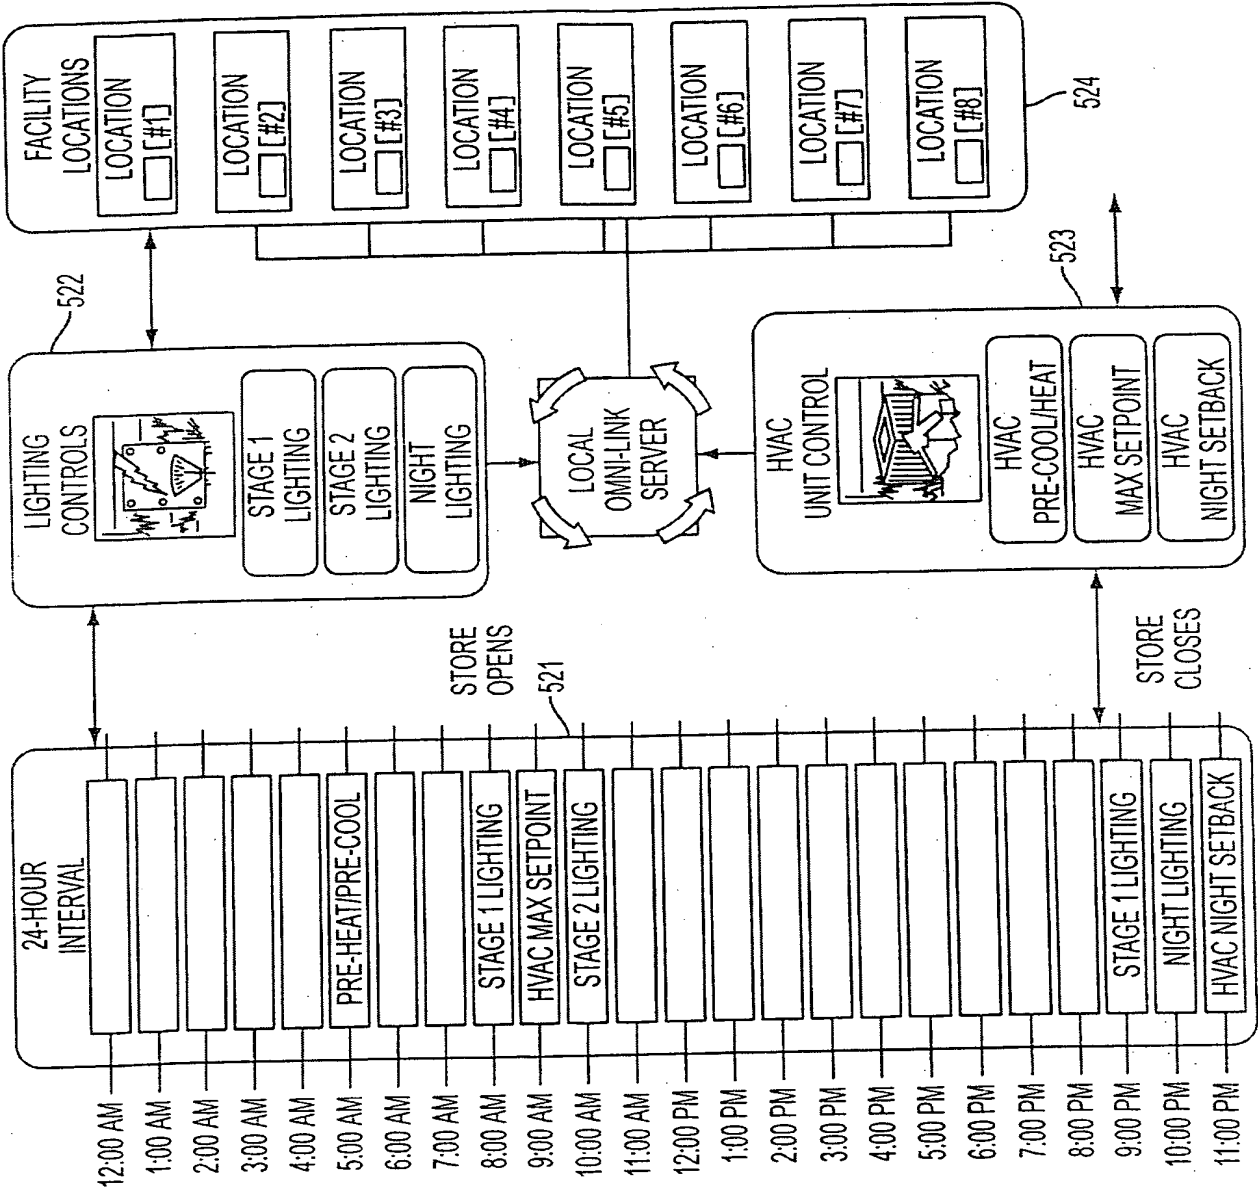


FIG. 24

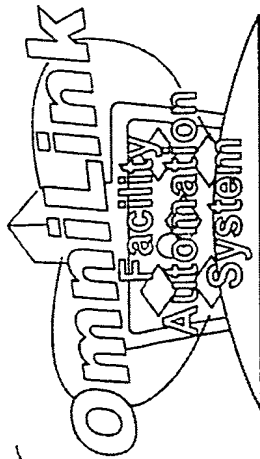

ENERGY PROCUREMENT NETWORK

NET BENEFITS:

- CENTRALIZED PROCUREMENT NETWORK
- LOW COST ELECTRICITY
- INSTANT CONSOLIDATION
- INSTANT AGGREGATION
- GRID PURCHASE / NO MIDDLEMAN

NET SAVINGS:

- APPROXIMATELY 10% LESS THAN THE DEREGULATED PRICE
- APPROXIMATE SAVINGS 2 TO 5 MILLS

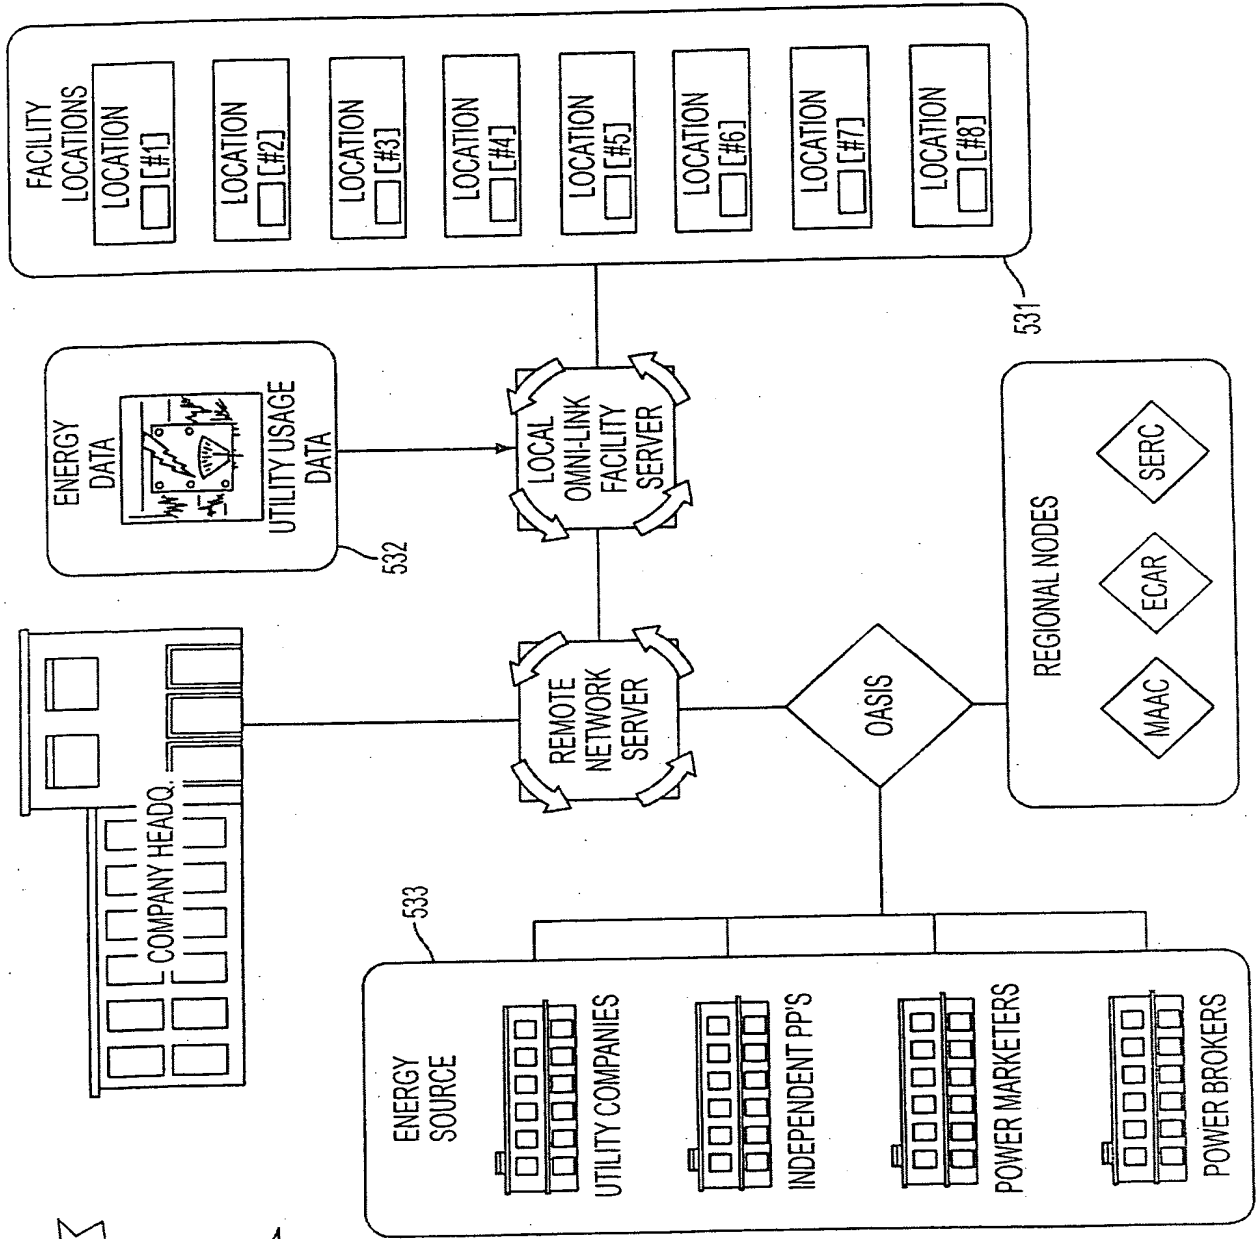


FIG. 25

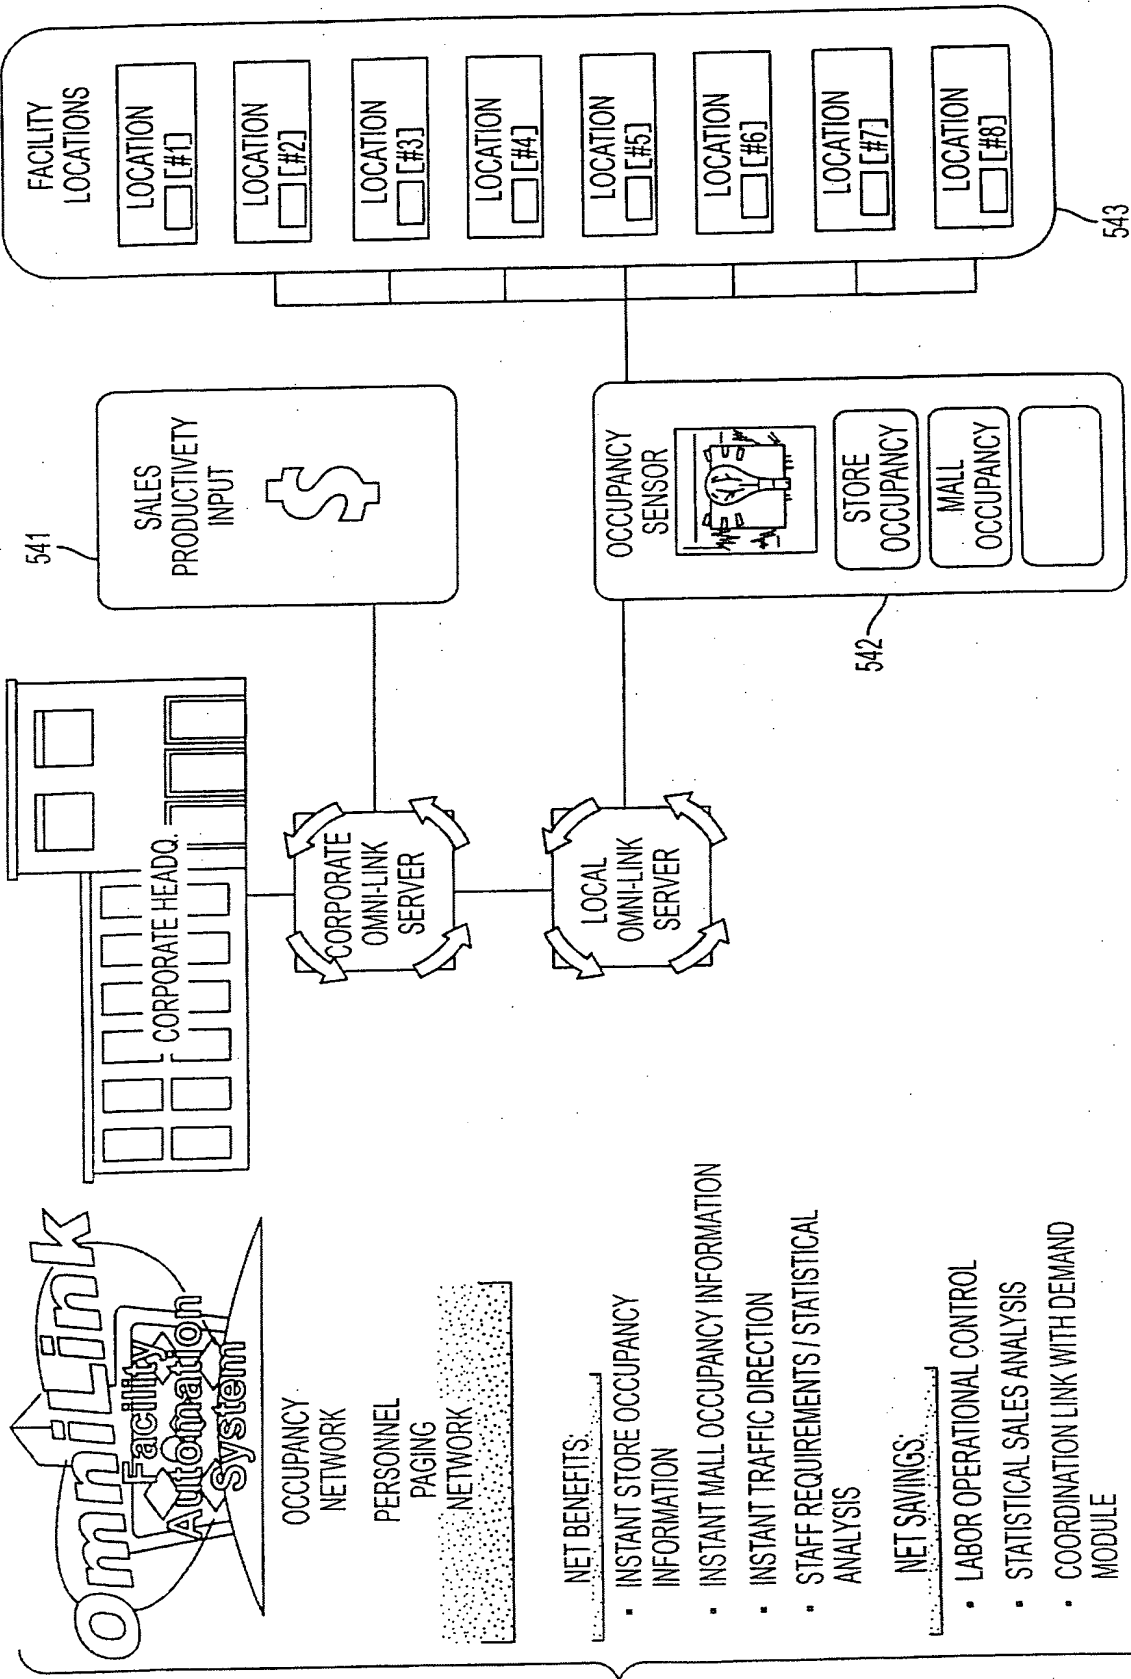


FIG. 26

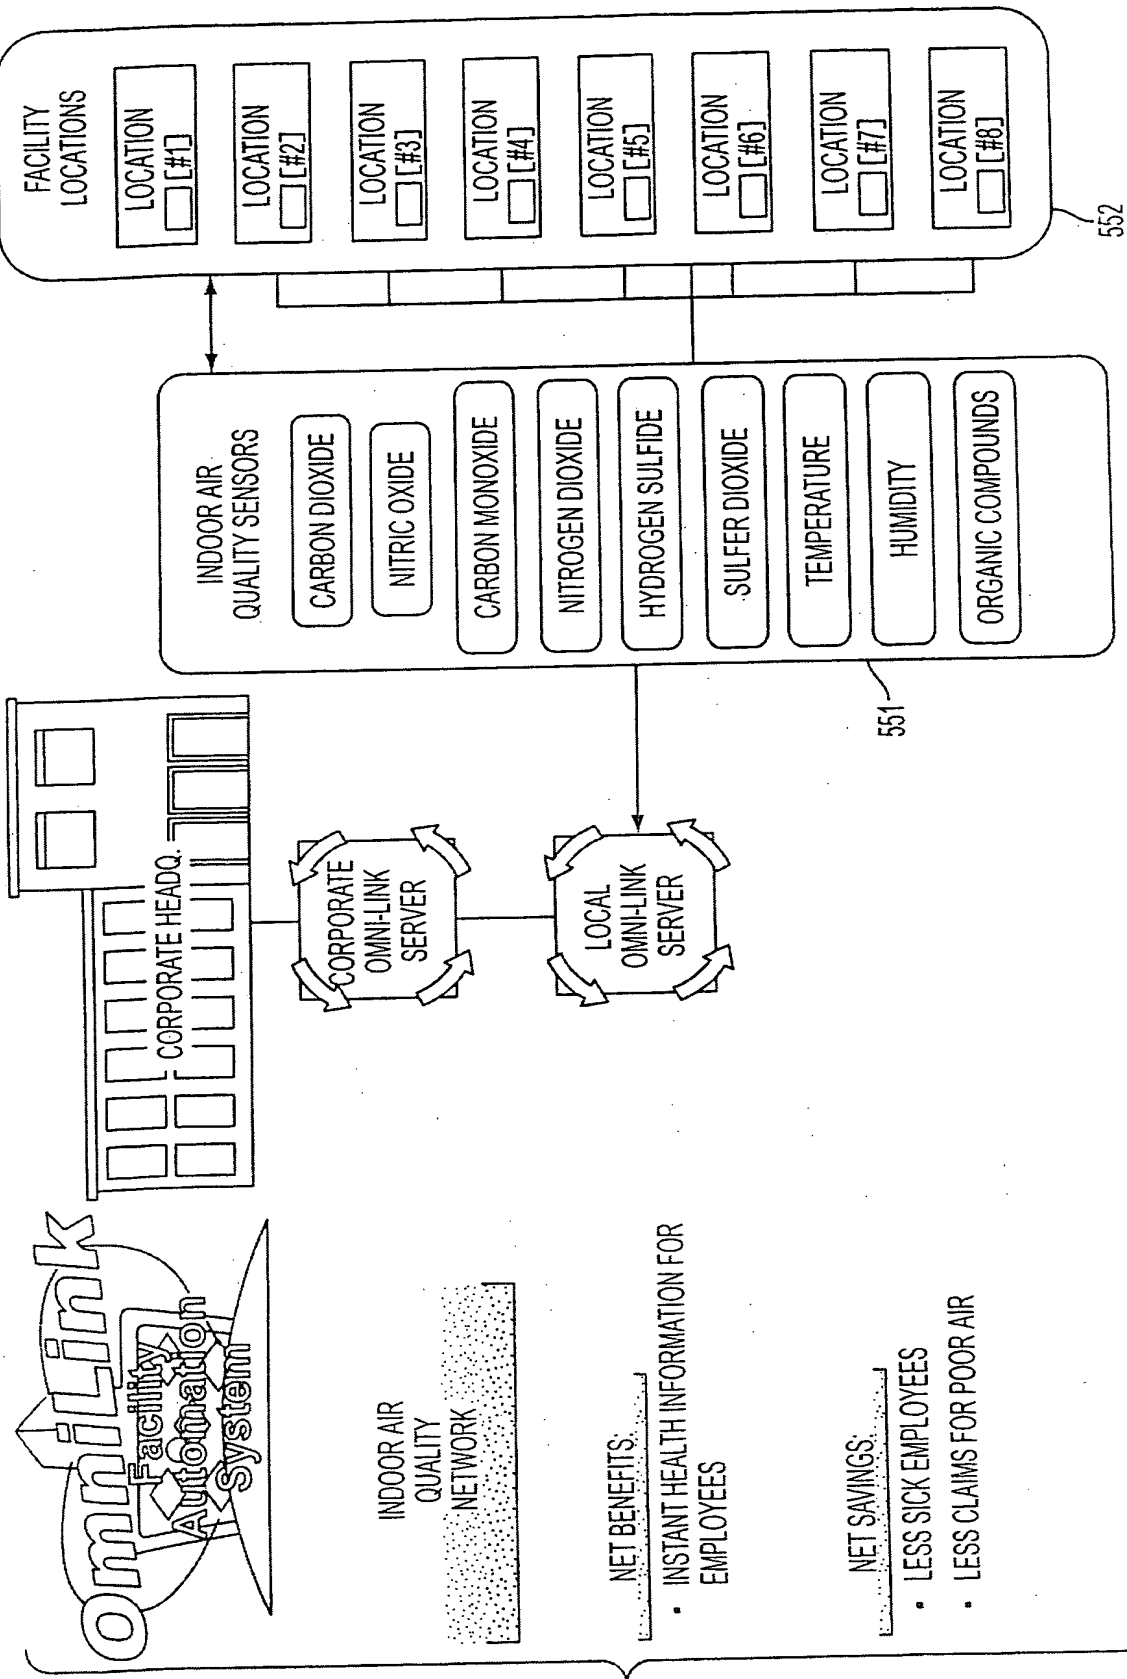


FIG. 27

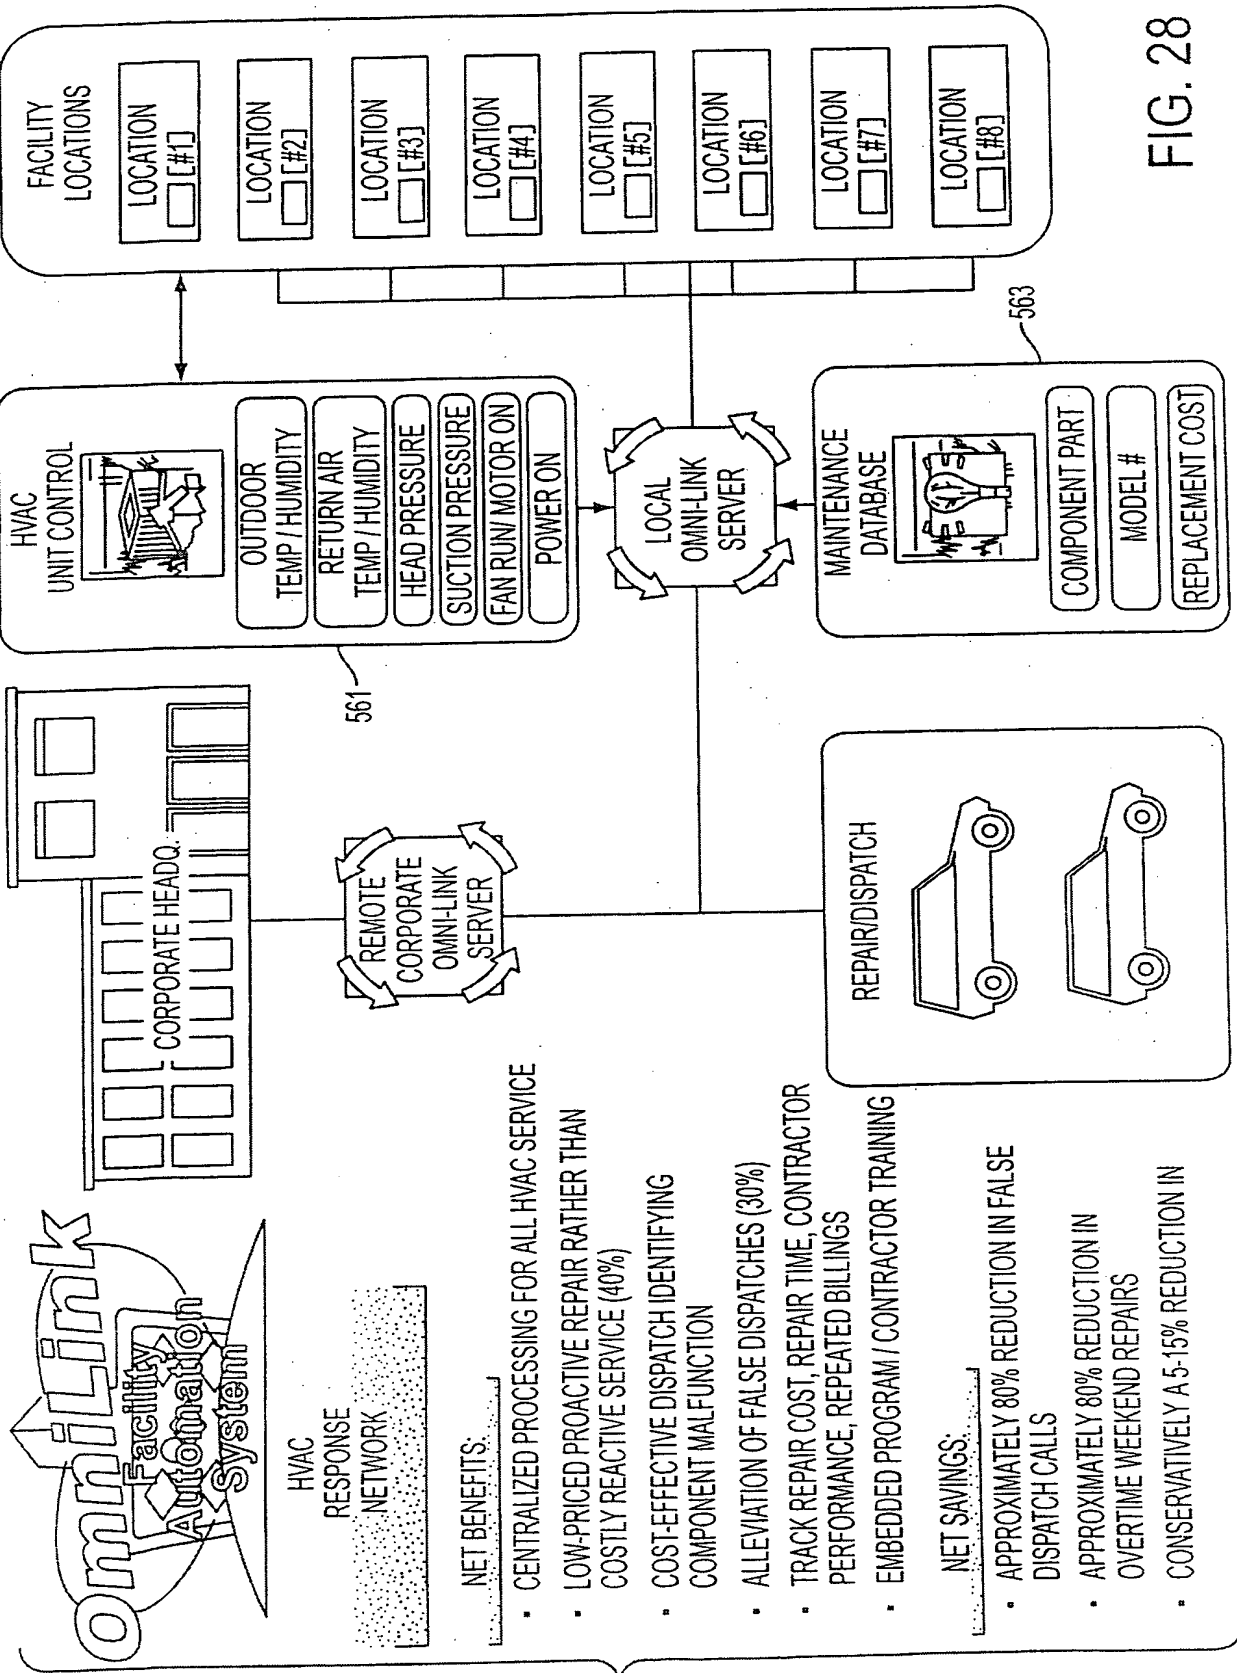


FIG. 28

**This Page is Inserted by IFW Indexing and Scanning
Operations and is not part of the Official Record**

BEST AVAILABLE IMAGES

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images include but are not limited to the items checked:

- ☐ **BLACK BORDERS**
- ☐ **IMAGE CUT OFF AT TOP, BOTTOM OR SIDES**
- ☐ **FADED TEXT OR DRAWING**
- ☐ **BLURRED OR ILLEGIBLE TEXT OR DRAWING**
- ☐ **SKEWED/SLANTED IMAGES**
- ☐ **COLOR OR BLACK AND WHITE PHOTOGRAPHS**
- ☐ **GRAY SCALE DOCUMENTS**
- ☐ **LINES OR MARKS ON ORIGINAL DOCUMENT**
- ☐ **REFERENCE(S) OR EXHIBIT(S) SUBMITTED ARE POOR QUALITY**
- ☐ **OTHER:** _____

IMAGES ARE BEST AVAILABLE COPY.

As rescanning these documents will not correct the image problems checked, please do not report these problems to the IFW Image Problem Mailbox.